




Chillers

Commercial and Technical Data

Water Cooled Chiller

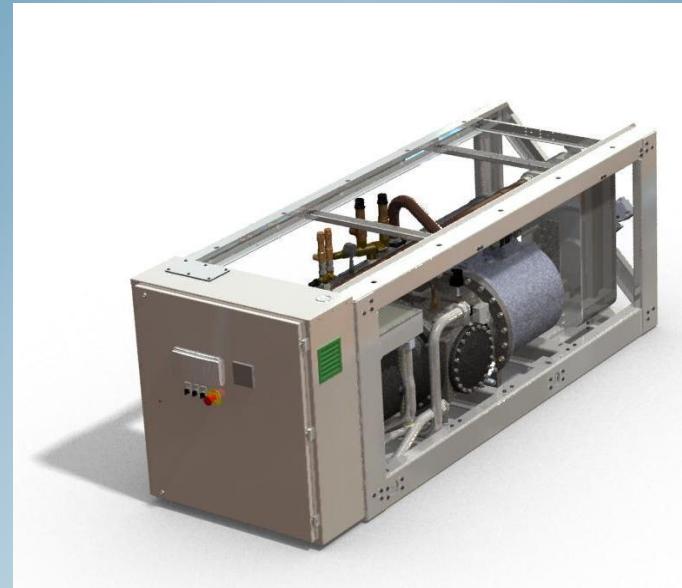

www.daikin.eu

EWWD-J-

Index

Features and advantages	3
Features and advantages	3
Seasonal quietness	3
Infinitely capacity control	3
Code requirements – Safety and observant of laws/directives	3
Certifications.....	4
Versions	4
Sound configuration.....	4
General characteristics	5
Cabinet and structure	5
Screw compressors	5
Ecological HFC 134a refrigerant	5
Evaporator	5
Condenser.....	5
Electronic expansion valve	5
Refrigerant Circuit.....	5
Electrical control panel	6
Standard accessories (supplied on basic unit)	7
Nomenclature	9
Technical Specifications	10
EWWD~J-SS.....	10
Sound levels	16
Sound pressure level correction for different distances	16
Operating limits.....	17
How to use the Correction factors proposed in the previous tables.....	18
Water charge, flow and quality	20
Water content in cooling circuits	21
Standard ratings.....	22
EWWD120~250J-SS	22
EWWD280~400J-SS	24
EWWD450~560J-SS	26
Evaporator and condenser pressure drops.....	28
EWWD~J-SS.....	28
Dimensions.....	29
EWWD~J-SS / 1 circuit.....	29
EWWD~J-SS / 2 circuits	30
Installation notes.....	31
Warning	31
Warning	31
Handling	31
Location	31
Minimum space requirements	31
Technical specification for water cooled screw chillers.....	32
General.....	32
Refrigerant.....	32
Performance.....	32
Unit description.....	32
Noise level and vibration	32
Dimension	32
Chiller components.....	33

Features and advantages

Features and advantages

The EWWD~J- water cooled chillers, featuring 1 or 2 single screw compressors, are manufactured to satisfy the requirements of the consultants and the end user. Units are designed to minimise energy costs while maximising the refrigeration capacities.

Daikin's chiller design experience, combined with outstanding features makes the EWWD~J- chiller unmatched in the industry.

Seasonal quietness


The compressor design with a single screw and twin rotors allows a constant gas flow. This compression process completely eliminates gas pulsations. The oil injection also results in significant mechanical noise reduction.

The twin gas compressor discharge chambers are designed to act as attenuators, based on the harmonic wave principle with destructive interference, thus always resulting equal to zero. The extremely low noise compressor performance affords the use of EWWD~J- chiller for all applications.

The reduced number of vibrations produced from the EWWD~J- chiller offers a surprisingly quiet operation eliminating the noise transmission through the structure and the chilled water piping system.


Infinitely capacity control

Cooling capacity is infinitely variable by means of a screw compressor controlled by microprocessor system. Each unit has infinitely variable capacity control from 100% down to 25% (one compressor unit) and down to 12,5% (two compressors units). This modulation allows the compressor capacity to exactly match the building cooling load without any leaving evaporator water temperature fluctuation. This chilled water temperature fluctuation is avoided only with a stepless control.

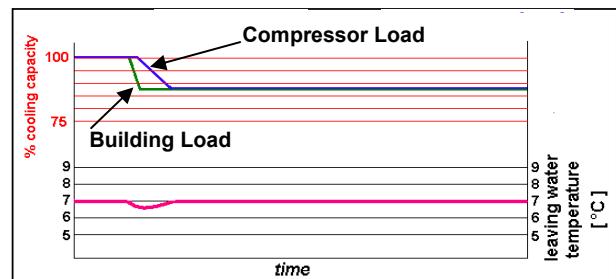

EWLT fluctuation with stepless capacity control

With a compressor load step control in fact, the compressor capacity, at partial loads, will be too high or too low compared to the building cooling load. The result is an increase in chiller energy costs, particularly at the part-load conditions at which the chiller operates most of the time.

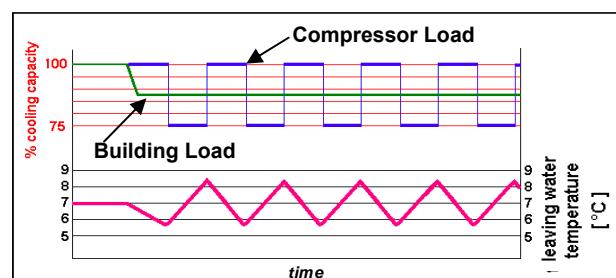

ELWT fluctuation with steps capacity control (4 steps)

Units with stepless regulation offer benefits that the units with step regulation are unable to match. The ability to follow the system energy demand at any time and the possibility to provide steady outlet water temperature without deviations from the set-point, are the two points that allow you to understand how the optimum operating conditions of a system can be met only through the use of a unit with step-less regulation.

Code requirements – Safety and observant of laws/directives

All water cooled units are designed and manufactured in accordance with applicable selections of the following:

Construction of pressure vessel	97/23/EC (PED)
Machinery Directive	2006/42/EC
Low Voltage	2006/95/EC
Electromagnetic Compatibility	2004/108/EC
Electrical & Safety codes	EN 60204-1 / EN 60335-2-40
Manufacturing Quality Stds	UNI – EN ISO 9001:2004

Certifications

All units manufactured are CE marked, complying with European directives in force, concerning manufacturing and safety. On request units can be produced complying with laws in force in non European countries (ASME, GOST, etc.), and with other applications, such as naval (RINA, etc.).

Versions

EWWD~J- is available in standard efficiency version:

S: Standard Efficiency

16 sizes, covering a cooling capacity range from 121 up to 571 kW, EER up to 4.41 and ESEER up to 5.37.

The EER (Energy Efficiency Ratio) is the ratio of the Cooling Capacity to the Power Input of the unit. The Power Input includes: the power input for operation of the compressor, the power input of all control and safety devices.

The ESEER (European Seasonal Energy Efficiency Ratio) is a weighed formula enabling to take into account the variation of EER with the load rate and the variation of water inlet condenser temperature.

$$\text{ESEER} = A \times \text{EER}_{100\%} + B \times \text{EER}_{75\%} + C \times \text{EER}_{50\%} + D \times \text{EER}_{25\%}$$

	A	B	C	D
Coefficient	0.03 (3%)	0.33 (33%)	0.41 (41%)	0.23 (23%)
Condenser water inlet temperature (°C)	30	26	22	18

Sound configuration

EWWD~J- is available in standard sound level configuration:

S: Standard Noise

General characteristics

Cabinet and structure

The cabinet is made of galvanized steel sheet and painted to provide a high resistance to corrosion. Colour Ivory White (Munsell code 5Y7.5/1) (\pm RAL7044). The base frame has eye-hook for lifting the unit with ropes for an easy installation. The weight is uniformly distributed along the profiles of the base and this facilitates the arrangement of the unit.

Screw compressors

The compressor is semi-hermetic, single-screw type with gate-rotors made of carbon impregnated engineered composite material. The compressor has one slide managed by the unit microprocessor for infinitely modulating the capacity between 100% to 25%. An integrated high efficiency oil separator maximizes the oil separation and standard start is Wye-delta (Y- Δ) type.

Ecological HFC 134a refrigerant

The compressors have been designed to operate with R-134a, ecological refrigerant with zero ODP (Ozone Depletion Potential) and very low GWP (Global Warming Potential) that means low TEWI (Total Equivalent Warming Impact).

Evaporator

The units are equipped with direct expansion plate to plate type evaporator, one per circuit. This heat exchanger is made of stainless steel brazed plates and is covered with a 10mm closed cell insulation material. The evaporator is manufactured in accordance to PED approval. The evaporator water outlet connections are provided with Victaulic Kit (as standard).

Condenser

The units are equipped with Direct Expansion shell & tube condenser, with copper tubes rolled into steel tube sheets. The unit has independent condensers, one per circuit. The condenser is manufactured in accordance to PED approval.

Condensers are provided with liquid shut-off valve and spring loaded relief valve.

The condenser water outlet connections are provided with Victaulic Kit (as standard).

Electronic expansion valve

The unit is equipped with the most advanced electronic expansion valves to achieve precise control of refrigerant mass flow. As today's system requires improved energy efficiency, tighter temperature control, wider range of operating conditions and incorporate features like remote monitoring and diagnostics, the application of electronic expansion valves becomes mandatory.

Electronic expansion valve proposes features that make it unique: short opening and closing time, high resolution, positive shut-off function to eliminate use of additional solenoid valve, highly linear flow capacity, continuous modulation of mass flow without stress in the refrigerant circuit and corrosion resistance stainless steel body.

Electronic expansion valve strength point is the capacity to work with lower ΔP between high and low pressure side, than a thermostatic expansion valve. The electronic expansion valve allows the system to work with low condenser pressure (winter time) without any refrigerant flow problems and with a perfect chilled water leaving temperature control.

Refrigerant Circuit

Each unit has independent refrigerant circuits and each one includes:

- Single screw compressor with integrated oil separator
- Brazed plate evaporator
- Shell & tube condenser
- Oil pressure transducer
- High pressure switches
- High pressure transducer
- Low pressure transducer
- Moisture liquid indicator
- Replaceable core filter-drier
- Electronic expansion valve

Electrical control panel

Power and control are located in the main panel that is manufactured to ensure protection against all weather conditions. The electrical panel is IP54 and (when opening the doors) internally protected with Plexiglas panel against possible accidental contact with electrical components (IP20). The main panel is fitted with a main switch interlocked door.

Power Section

The power section includes compressors fuses and control circuit transformer.

MicroTech III controller

MicroTech III controller is installed as standard; it can be used to modify unit set-points and check control parameters. A built-in display shows chiller operating status plus temperatures and pressures of water, refrigerant, programmable values, set-points. A sophisticated software with predictive logic, selects the most energy efficient combination of compressors and electronic expansion valve to keep stable operating conditions to maximise chiller energy efficiency and reliability.

MicroTech III is able to protect critical components based on external signs from its system (such as motor temperatures, refrigerant gas and oil pressures, correct phase sequence, pressure switches and evaporator). The input coming from the high pressure switch cuts all digital output from the controller in less than 50ms, this is an additional security for the equipment.

Fast program cycle (200ms) for a precise monitoring of the system. Floating point calculations supported for increased accuracy in P/T conversions.

Control section - main features

- Management of the compressor stepless capacity.
- Chiller enabled to work in partial failure condition.
- Full routine operation at condition of:
 - high ambient temperature value
 - high thermal load
 - high evaporator entering water temperature (start-up)
- Display of evaporator entering/leaving water temperatures.
- Display of condensing-evaporating temperatures and pressures, suction and discharge superheat for each circuit.
- Leaving water evaporator temperature regulation. Temperature tolerance = 0,1°C.
- Compressor and evaporator pumps hour counters.
- Display of Status Safety Devices.
- Number of starts and compressor working hours.
- Optimized management of compressor load.
- Re-start in case of power failure (automatic / manual).
- Soft Load (optimized management of the compressor load during the start-up).
- Start at high evaporator water temperature.
- Return Reset (Set Point Reset based on return water temperature).
- Set point Reset (optional).
- Application and system upgrade with commercial SD cards.
- Ethernet port for remote or local servicing using standard web browsers.
- Two different sets of default parameters could be stored for easy restore.

Safety device / logic for each refrigerant circuit

- High pressure (pressure switch).
- High pressure (transducer).
- Low pressure (transducer).
- High compressor discharge temperature.
- High motor winding temperature.
- Phase Monitor.
- Low pressure ratio.
- High oil pressure drop
- Low oil pressure.

- No pressure change at start.

System security

- Phase monitor.
- Low Ambient temperature lock-out.
- Freeze protection.

Regulation type

Proportional + integral + derivative regulation on the evaporator leaving water output probe.

MicroTech III

MicroTech III built-in terminal has the following features.

- 164x44 dots liquid crystal display with white back lighting. Supports Unicode fonts for multi-lingual.
- Key-pad consisting of 3 keys.
- Push'n'Roll control for an increased usability.
- Memory to protect the data.
- General faults alarm relays.
- Password access to modify the setting.
- Application security to prevent application tampering or hardware usability with third party applications.
- Service report displaying all running hours and general conditions.
- Alarm history memory to allow an easy fault analysis.

Supervising systems (on request)

MicroTech III remote control

MicroTech III is able to communicate to BMS (Building Management System) based on the most common protocols as:

- ModbusRTU
- LonWorks, now also based on the international 8040 Standard Chiller Profile and LonMark Technology
- BacNet BTP certifie over IP and MS/TP (class 4) (Native)

Chiller Sequencing

MicroTech III controller allows an easy plug-in sequencing technology based on digital or serial panel

Digital Sequencing Panel

This panel is basically a step inserter that switches ON/OFF up to 11 units (chillers or heat pumps operating in the same cooling/heating mode) depending on the selected set point; the units are connected with the panel through standard cables and no serial card is requested.

Serial Sequencing Panel

Basically this panel sequences a chiller plant by switching on/off the units (up to 7 chillers) taking into account their running hours and the requested plant load, in order to optimise the number of working units for each condition; serial cards and shielded cables are requested to connect the panel with the units and, if installed, a BMS.

Standard accessories (supplied on basic unit)

Evaporator Victaulic Kit - Hydraulic joint with gasket for an easy and quick water connection.

20mm Evaporator Insulation

Condenser Victaulic kit

Condenser Water side design pressure 16 bar

Condenser 2 passes (Δt 4-8°C)

Suction line shut off valve - Suction shut-off valve installed on the suction of the compressor to facilitate maintenance operation.

Discharge line shut-off valves - Discharge shut-off valve installed on the discharge of the compressor to facilitate maintenance operations.

Electronic Expansion Valve

High Pressure Side Manometers

Y-D starter - Star Delta starter is the standard type

Double set-point - Dual leaving water temperature set-points.

Phase monitor - The phase monitor controls that phases sequence is correct and controls phase loss.

Evaporator flow switch for the water piping

Hour Run meter - Digital compressors hour run meter

General fault contactor - Contactor for alarm warning.

Main switch interlock

Emergency stop

Options (on request)

Heat pump version

Brine version – Allows the unit to operate down to -8°C leaving liquid temperature (antifreeze required).

Compressor thermal overload relays - Safety devices against compressor motor overloading in addition to the normal protection envisaged by the electrical windings.

Evaporator Water side design pressure 16 bar

20mm Condenser insulation

Condenser double flanges kit

Water pressure differential switch on evaporator

Sound Proof System - Compressor sound enclosure.

Rubber type antivibration mounts – Supplied separately, these are positioned under the base of the unit during installation. Ideal to reduce the vibrations when the unit is floor mounted

Fork lift kit

Low pressure side manometers

Dual Pressure Relief Valve on evaporator

Under/Over Voltage – This device control the voltage value of power supply and stop the chiller if the value exceeds the allowed operating limits.

Energy Meter – This device allows to measure the energy absorbed by the chiller during its life. It is installed inside the control box mounted on a DIN rail and show on a digital display: Line-to-Line Voltage, Phase and Average Current, Active and Reactive Power, Active Energy, Frequency.

Condenser power factor correction - Installed on the electrical control panel to ensure it conforms to the plant rules. (Daikin advices maximum 0,9).

Current limit display

Witness test – Every unit is always tested at the test bench prior to the shipment. On request, a second test can be carried out, at customer's presence, in accordance with the procedures indicated on the test form. (Not available for units with glycol mixtures).


Acoustic test – On request, a test can be carried out, at customer's presence (please contact the factory) (This test is not available for units with glycol mixtures).

Set-point reset, demand limit and alarm from external device – The leaving water temperature set-point can be overwritten with the following options: 4-20mA from external source (by user); outside ambient temperature; evaporator water temperature Δt . Moreover the device allow the user to limit the load of the unit by 4-20mA signal or by network system and the microprocessor is able to receive an alarm signal from an external device (pump etc... - user can decide if this alarm signal will stop or not the unit).

Automatic circuit breakers

Nomenclature

E	W	W	D	1	2	0	J	-	S	S	0	0	1
1	2	3	4	5	6	7	8	9	10	11	12	13	14

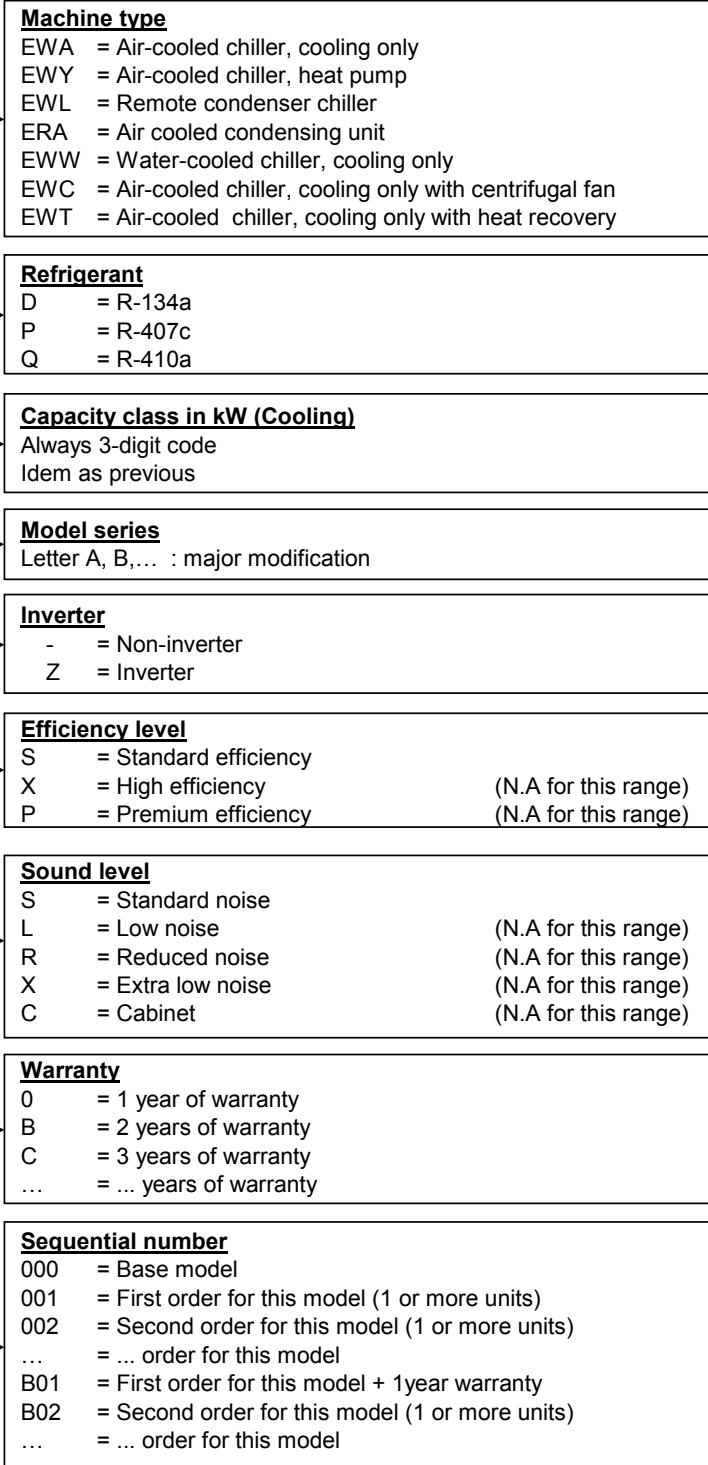

Technical Specifications

EWWD~J-SS

TECHNICAL SPECIFICATIONS			EWWD~J-SS	120	140	150	180
Capacity (1)	Cooling	kW	120	146	155	178	
Capacity control	Type	---		Stepless			
	Minimum capacity	%	25	25	25	25	
Unit power input (1)	Cooling	kW	27.3	33.3	38.5	44.2	
EER (1)		---	4.40	4.38	4.03	4.03	
ESEER		---	5.01	4.67	4.67	4.66	
Capacity (2)	Heating	kW	142	172	188	216	
Unit power input (2)	Heating	kW	32.9	40.1	46.4	53.5	
COP (2)		---	4.32	4.29	4.05	4.04	
Casing	Colour	---		Ivory White			
	Material	---		Galvanized and painted steel sheet			
Dimensions	Unit	Height	mm	1020	1020	1020	1020
		Width	mm	913	913	913	913
		Length	mm	2684	2684	2684	2684
Weight	Unit	kg	1177	1233	1334	1366	
	Operating Weight	kg	1211	1276	1378	1415	
Water heat exchanger Evaporator	Type	---		Brased plate, one per circuit			
	Water volume	l	14	18	14	17	
	Nominal water flow rate	Cooling	l/s	5.73	6.98	7.41	8.50
	Nominal Water pressure drop	Cooling	kPa	15	13	40	38
	Insulation material			Closed cell			
Water heat exchanger Condenser	Type	---		Double Pass Shell&Tube			
	Number of condenser	No.		One per circuit			
	Water volume	l	20	20	23	25	
	Nominal water flow rate	Cooling	l/s	7.04	8.57	9.25	10.62
	Nominal Water pressure drop	Cooling	kPa	20	12	11	11
Compressor	Insulation material			Closed cell			
	Type	---		Semi-hermetic single screw compressor			
	Oil charge	l	13	13	13	13	
Sound level	Quantity	No.	1	1	1	1	
	Sound Power (3)	Cooling	dB(A)	71.4	71.4	71.4	71.4
Refrigerant circuit	Sound Pressure (3)	Cooling	dB(A)	88.6	88.6	88.6	88.6
	Refrigerant type		---	R134a			
Piping connections	Refrigerant charge	kg.	18	20	33	34	
	N. of circuits	No.	1	1	1	1	
Piping connections	Evaporator water inlet/outlet	mm	76.2	76.2	76.2	76.2	
Piping connections	Condenser water inlet/outlet	inc.	2 _{1/2} "	4"	4"	4"	
Safety devices	High discharge pressure (pressure switch)						
	High discharge pressure (pressure transducer)						
	Low suction pressure (pressure transducer)						
	Compressor motor protection						
	High discharge temperature						
	Low oil pressure						
	Low pressure ratio						
	High oil filter pressure drop						
	Phase monitor						
	Emergency stop button						
Notes (1)	Water freeze protection controller						
	Cooling capacity, unit power input in cooling and EER are based on the following conditions: evaporator 12/7°C; condenser 30/35°C, unit at full load operation.						
Notes (2)	Heating capacity, unit power input in cooling and COP are based on the following conditions: evaporator 12/7°C; condenser 40/45°C, unit at full load operation.						
Notes (3)	The values are according to ISO 3744 and are referred to: evaporator 12/7°C, condenser 30/35°C, full load operation.						

TECHNICAL SPECIFICATIONS			EWWD~J-SS	210	250	280	310
Capacity (1)	Cooling	kW	208	256	285	310	
Capacity control	Type	---		Stepless			
	Minimum capacity	%	25	25	25	12.5	
Unit power input (1)	Cooling	kW	49.3	58.7	68.3	77	
EER (1)		---	4.22	4.37	4.18	4.03	
ESEER		---	4.75	5.20	4.46	4.80	
Capacity (2)	Heating	kW	249	305	340	377	
Unit power input (2)	Heating	kW	59.57	71.68	80.75	92.88	
COP (2)		---	4.18	4.26	4.21	4.06	
Casing	Colour	---		Ivory White			
	Material	---		Galvanized and painted steel sheet			
Dimensions	Unit	Height	mm	1020	1020	1020	2000
		Width	mm	913	913	913	913
		Length	mm	2684	2684	2684	2684
Weight	Unit	kg	1416	1600	1607	2668	
	Operating Weight	kg	1473	1663	1675	2755	
Water heat exchanger Evaporator	Type	---		Brased plate, one per circuit			
	Water volume	l	20	26	26	29	
	Nominal water flow rate	Cooling	l/s	9.94	12.25	13.63	14.81
	Nominal Water pressure drop	Cooling	kPa	36	28	33	40
	Insulation material			Closed cell			
Water heat exchanger Condenser	Type	---		Double Pass Shell&Tube			
	Number of condenser	No.		One per circuit			
	Water volume	l	29	29	32	45	
	Nominal water flow rate	Cooling	l/s	12.30	15.06	16.89	18.49
	Nominal Water pressure drop	Cooling	kPa	11	16	26	11
Compressor	Insulation material			Closed cell			
	Type	---		Semi-hermetic single screw compressor			
	Oil charge	l					
	Quantity	No.	1	1	1	2	
Sound level	Sound Power (3)	Cooling	dB(A)	71.4	70.0	70.0	74.4
	Sound Pressure (3)	Cooling	dB(A)	88.6	87.2	87.2	92.4
Refrigerant circuit	Refrigerant type	---		R134a			
	Refrigerant charge	kg.	36	38	38	66	
	N. of circuits	No.	1	1	1	2	
Piping connections	Evaporator water inlet/outlet	mm	76.2	76.2	76.2	76.2	
Piping connections	Condenser water inlet/outlet	inc.	4"	4"	4"	4"	
Safety devices	High discharge pressure (pressure switch)						
	High discharge pressure (pressure transducer)						
	Low suction pressure (pressure transducer)						
	Compressor motor protection						
	High discharge temperature						
	Low oil pressure						
	Low pressure ratio						
	High oil filter pressure drop						
	Phase monitor						
	Emergency stop button						
Notes (1)	Water freeze protection controller						
	Cooling capacity, unit power input in cooling and EER are based on the following conditions: evaporator 12/7°C; condenser 30/35°C, unit at full load operation.						
Notes (2)	Heating capacity, unit power input in heating and COP are based on the following conditions: evaporator 12/7°C; condenser 40/45°C, unit at full load operation.						
Notes (3)	The values are according to ISO 3744 and are referred to: evaporator 12/7°C, condenser 30/35°C, full load operation.						

TECHNICAL SPECIFICATIONS			EWWD~J-SS	330	360	380	400
Capacity (1)	Cooling	kW	334	357	386	416	
Capacity control	Type	---		Stepless			
	Minimum capacity	%	12.5	12.5	12.5	12.5	
Unit power input (1)	Cooling	kW	82.7	88.4	98.6	98.6	
EER (1)		---	4.04	4.04	3.91	4.22	
ESEER		---	4.84	5.00	4.79	5.17	
Capacity (2)	Heating	kW	405	432	466	499	
Unit power input (2)	Heating	kW	99.9	107	113	119	
COP (2)		---	4.05	4.04	4.12	4.19	
Casing	Colour	---		Ivory White			
	Material	---		Galvanized and painted steel sheet			
Dimensions	Unit	Height	mm	2000	2000	2000	2000
		Width	mm	913	913	913	913
		Length	mm	2684	2684	2684	2684
Weight	Unit	kg	2700	2732	2782	2832	
	Operating Weight	kg	2792	2830	2888	2946	
Water heat exchanger Evaporator	Type	---		Brased plate, one per circuit			
	Water volume	l	31	33	37	41	
	Nominal water flow rate	Cooling	l/s	15.96	17.06	18.44	19.88
	Nominal Water pressure drop	Cooling	kPa	40	38	38	36
	Insulation material			Closed cell			
Water heat exchanger Condenser	Type	---		Double Pass Shell&Tube			
	Number of condenser	No.		One per circuit			
	Water volume	l	48	51	54	57	
	Nominal water flow rate	Cooling	l/s	19.91	21.28	23.15	24.59
	Nominal Water pressure drop	Cooling	kPa	11	11	11	11
Compressor	Insulation material			Closed cell			
	Type	---		Semi-hermetic single screw compressor			
	Oil charge	l	26	26	26	26	
	Quantity	No.	2	2	2	2	
Sound level	Sound Power (3)	Cooling	dB(A)	74.4	74.4	74.4	74.4
	Sound Pressure (3)	Cooling	dB(A)	92.4	92.4	92.4	92.4
Refrigerant circuit	Refrigerant type	---		R134a			
	Refrigerant charge	kg.	67	68	70	72	
	N. of circuits	No.	2	2	2	2	
Piping connections	Evaporator water inlet/outlet	mm	76.2	76.2	76.2	76.2	
Piping connections	Condenser water inlet/outlet	inc.	4"	4"	4"	4"	
Safety devices	High discharge pressure (pressure switch)						
	High discharge pressure (pressure transducer)						
	Low suction pressure (pressure transducer)						
	Compressor motor protection						
	High discharge temperature						
	Low oil pressure						
	Low pressure ratio						
	High oil filter pressure drop						
	Phase monitor						
	Emergency stop button						
Notes (1)	Cooling capacity, unit power input in cooling and EER are based on the following conditions: evaporator 12/7°C; condenser 30/35°C, unit at full load operation.						
	Heating capacity, unit power input in heating and COP are based on the following conditions: evaporator 12/7°C; condenser 40/45°C, unit at full load operation.						
Notes (3)	The values are according to ISO 3744 and are referred to: evaporator 12/7°C, condenser 30/35°C, full load operation.						

TECHNICAL SPECIFICATIONS			EWWD~J-SS	450	500	530	560
Capacity (1)	Cooling	kW	464	513	541	570	
Capacity control	Type	---		Stepless			
	Minimum capacity	%	12.5	12.5	12.5	12.5	
Unit power input (1)	Cooling	kW	108	117	127	137	
EER (1)		---	4.30	4.38	4.26	4.16	
ESEER		---	5.27	5.37	5.25	4.81	
Capacity (2)	Heating	kW	554	610	645	681	
Unit power input (2)	Heating	kW	131	143	152	162	
COP (2)		---	4.22	4.26	4.23	4.22	
Casing	Colour	---		Ivory White			
	Material	---		Galvanized and painted steel sheet			
Dimensions	Unit	Height	mm	2000	2000	2000	2000
		Width	mm	913	913	913	913
		Length	mm	2684	2684	2684	2684
Weight	Unit	kg	3016	3200	3207	3215	
	Operating Weight	kg	3136	3327	3338	3350	
Water heat exchanger Evaporator	Type	---		Brased plate, one per circuit			
	Water volume	l	46	52	52	52	
	Nominal water flow rate	Cooling	l/s	22.17	24.51	25.85	27.23
	Nominal Water pressure drop	Cooling	kPa	36	28	28	33
	Insulation material			Closed cell			
Water heat exchanger Condenser	Type	---		Double Pass Shell&Tube			
	Number of condenser	No.		One per circuit			
	Water volume	l	57	57	61	64	
	Nominal water flow rate	Cooling	l/s	27.33	30.10	31.92	33.78
	Nominal Water pressure drop	Cooling	kPa	11	16	16	26
Compressor	Insulation material			Closed cell			
	Type	---		Semi-hermetic single screw compressor			
	Oil charge	l	29	32	32	32	
	Quantity	No.	2	2	2	2	
Sound level	Sound Power (3)	Cooling	dB(A)	73.8	73.0	73.0	73.0
	Sound Pressure (3)	Cooling	dB(A)	91.8	91.0	91.0	91.0
Refrigerant circuit	Refrigerant type	---		R134a			
	Refrigerant charge	kg.	74	76	76	76	
	N. of circuits	No.	2	2	2	2	
Piping connections	Evaporator water inlet/outlet	mm	76.2	76.2	76.2	76.2	
Piping connections	Condenser water inlet/outlet	inc.	4"	4"	4"	4"	
Safety devices	High discharge pressure (pressure switch)						
	High discharge pressure (pressure transducer)						
	Low suction pressure (pressure transducer)						
	Compressor motor protection						
	High discharge temperature						
	Low oil pressure						
	Low pressure ratio						
	High oil filter pressure drop						
	Phase monitor						
	Emergency stop button						
Notes (1)	Water freeze protection controller						
	Cooling capacity, unit power input in cooling and EER are based on the following conditions: evaporator 12/7°C; condenser 30/35°C, unit at full load operation.						
Notes (2)	Heating capacity, unit power input in heating and COP are based on the following conditions: evaporator 12/7°C; condenser 40/45°C, unit at full load operation.						
Notes (3)	The values are according to ISO 3744 and are referred to: evaporator 12/7°C, condenser 30/35°C, full load operation.						

ELECTRICAL SPECIFICATIONS			EWWD~J-SS	120	140	150	180
Power Supply	Phase	---		3	3	3	3
	Frequency	Hz		50	50	50	50
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
Unit	Maximum starting current	A		151	151	195	195
	Nominal running current cooling	A		47	57	68	75
	Maximum running current	A		80	96	107	121
	Maximum current for wires sizing	A		88	106	118	133
Compressor	Phase	No.		3	3	3	3
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
	Maximum running current	A		80	96	107	121
Starting method			---	Wye – Delta type (Y – Δ)			

ELECTRICAL SPECIFICATIONS			EWWD~J-SS	210	250	280	310
Power Supply	Phase	---		3	3	3	3
	Frequency	Hz		50	50	50	50
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
Unit	Maximum starting current	A		195	288	288	281
	Nominal running current cooling	A		85	99	113	135
	Maximum running current	A		145	161	182	214
	Maximum current for wires sizing	A		160	177	200	235
Compressor	Phase	No.		3	3	3	3
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
	Maximum running current	A		145	161	182	107+107
Starting method			---	Wye – Delta type (Y – Δ)			

Notes	Allowed voltage tolerance $\pm 10\%$. Voltage unbalance between phases must be within $\pm 3\%$
	Maximum starting current: starting current of biggest compressor + current of compressors at 75% maximum load
	Nominal current in cooling mode refers to the following conditions: evaporator 12°C/7°C; condenser 30/35°C
	Maximum running current is based on max compressor absorbed current in its envelope
	Maximum unit current for wires sizing is based on minimum allowed voltage
	Maximum current for wires sizing: (compressors full load ampere) $\times 1,1$

ELECTRICAL SPECIFICATIONS			EWWD~J-SS	330	360	380	400
Power Supply	Phase	---		3	3	3	3
	Frequency	Hz		50	50	50	50
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
Unit	Maximum starting current	A		292	292	311	311
	Nominal running current cooling	A		143	150	160	169
	Maximum running current	A		228	242	266	290
	Maximum current for wires sizing	A		251	266	293	319
Compressor	Phase	No.		3	3	3	3
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
	Maximum running current	A		107+121	121+121	121+145	145+145
Starting method			---	Wye – Delta type (Y – Δ)			

ELECTRICAL SPECIFICATIONS			EWWD~J-SS	450	500	530	560
Power Supply	Phase	---		3	3	3	3
	Frequency	Hz		50	50	50	50
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-0.1
		Maximum	%	+10%	+10%	+10%	+10%
Unit	Maximum starting current	A		404	417	434	434
	Nominal running current cooling	A		183	197	212	226
	Maximum running current	A		306	322	343	364
	Maximum current for wires sizing	A		337	354	377	400.4
Compressor	Phase	No.		3	3	3	3
	Voltage	V		400	400	400	400
	Voltage Tolerance	Minimum	%	-10%	-10%	-10%	-10%
		Maximum	%	+10%	+10%	+10%	+10%
	Maximum running current	A		145+161	161+161	161+182	182+182
Starting method			---	Wye – Delta type (Y – Δ)			

Notes	Allowed voltage tolerance ± 10%. Voltage unbalance between phases must be within ± 3%
	Maximum starting current: starting current of biggest compressor + current of compressors at 75% maximum load
	Nominal current in cooling mode refers to the following conditions: evaporator 12°C/7°C; condenser 30/35°C
	Maximum running current is based on max compressor absorbed current in its envelope
	Maximum unit current for wires sizing is based on minimum allowed voltage
	Maximum current for wires sizing: (compressors full load ampere) x 1,1

Sound levels

EWWD~J-SS

Unit size	Sound pressure level at 1 m from the unit in semispheric free field (rif. 2×10^{-5} Pa)									Power dB(A)
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB(A)	
120	57.0	61.5	66.5	70.9	66.0	63.6	51.0	48.1	71.4	88.6
140	57.0	61.5	66.5	70.9	66.0	63.6	51.0	48.1	71.4	88.6
150	57.0	61.5	66.5	70.9	66.0	63.6	51.0	48.1	71.4	88.6
180	57.0	61.5	66.5	70.9	66.0	63.6	51.0	48.1	71.4	88.6
210	57.0	61.5	66.5	70.9	66.0	63.6	51.0	48.1	71.4	88.6
250	58.3	58.3	63.8	68.8	63.3	64.3	53.3	49.8	70.0	87.2
280	58.3	58.3	63.8	68.8	63.3	64.3	53.3	49.8	70.0	87.2
310	60.0	64.5	69.5	73.9	69.0	66.6	54.0	51.1	74.4	92.4
330	60.0	64.5	69.5	73.9	69.0	66.6	54.0	51.1	74.4	92.4
360	60.0	64.5	69.5	73.9	69.0	66.6	54.0	51.1	74.4	92.4
380	60.0	64.5	69.5	73.9	69.0	66.6	54.0	51.1	74.4	92.4
400	60.0	64.5	69.5	73.9	69.0	66.6	54.0	51.1	74.4	92.4
450	60.7	63.2	68.4	73.0	67.9	67.0	55.3	52.0	73.8	91.8
500	61.3	61.3	66.8	71.8	66.3	67.3	56.3	52.8	73.0	91.0
530	61.3	61.3	66.8	71.8	66.3	67.3	56.3	52.8	73.0	91.0
560	61.3	61.3	66.8	71.8	66.3	67.3	56.3	52.8	73.0	91.0

(1) The values are according to ISO 3744 and are referred to: evaporator 12/7° C, condenser 30/35° C, full load operation.

(2) The above sound pressure levels will decrease by 4dB(A) when a compressor sound enclosure (option) is installed.

Sound pressure level correction for different distances

Unit size	Distance					
	1m	5m	10m	15m	20m	25m
120	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
140	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
150	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
180	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
210	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
250	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
280	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
310	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
330	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
360	0.0	-7.9	-12.7	-15.8	-18.1	-19.8
380	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
400	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
450	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
500	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
530	0.0	-7.5	-12.2	-15.3	-17.5	-19.3
560	0.0	-7.5	-12.2	-15.3	-17.5	-19.3

(1) The values are dB(A) (pressure level).

Operating limits

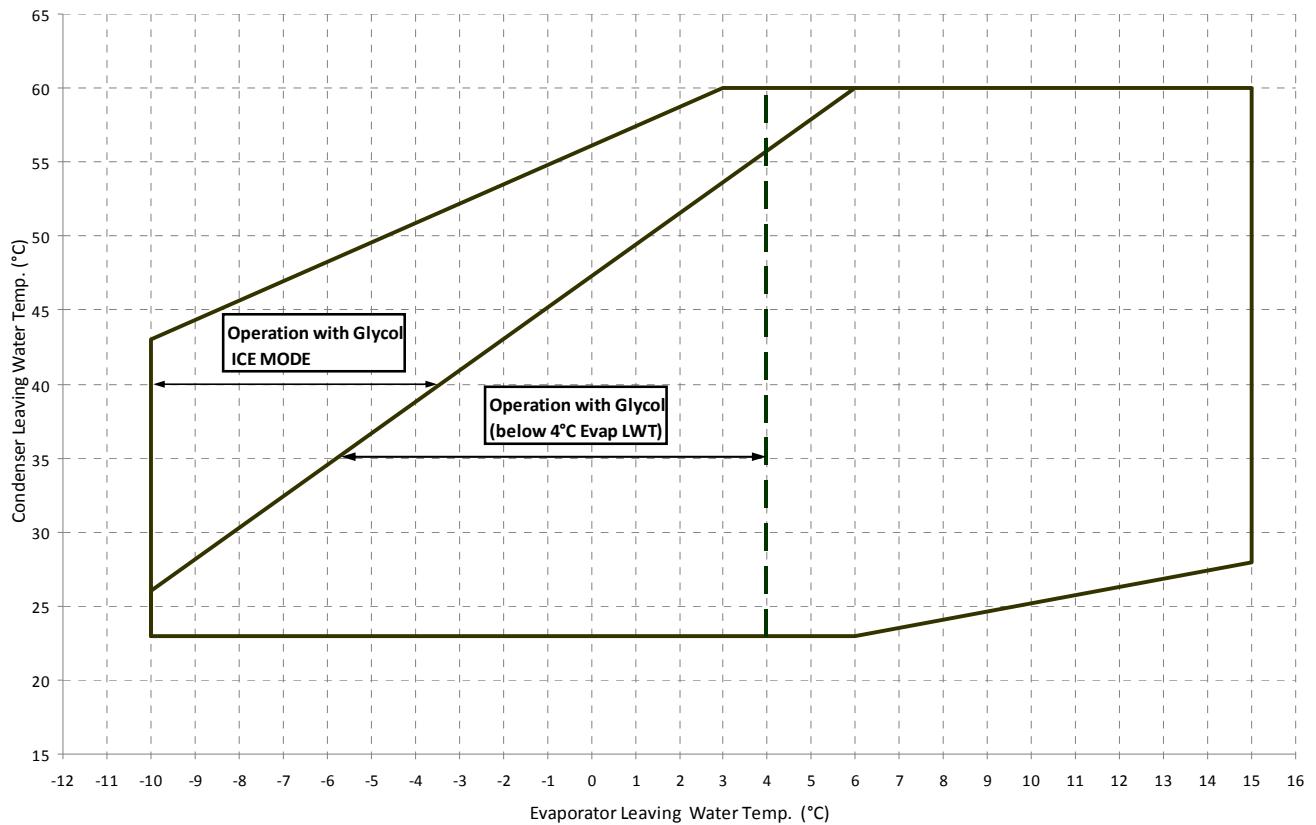


Table 1 - Evaporator/Condenser minimum and maximum water Δt

Max evaporator water Δt	°C	8
Min evaporator water Δt	°C	4
Min condenser water Δt	°C	4
Max condenser water Δt	°C	8

Table 2 - Evaporator fouling factors

Fouling factors $m^2 \text{°C} / \text{kW}$	Cooling capacity correction factor	Power input correction factor	EER correction factor
0.0176	1.000	1.000	1.000
0.0440	0.978	0.986	0.992
0.0880	0.957	0.974	0.983
0.1320	0.938	0.962	0.975

Table 3 - Condenser fouling factors

Fouling factors $m^2 \text{°C} / \text{kW}$	Cooling capacity correction factor	Power input correction factor	EER correction factor
0.0176	1.000	1.000	1.000
0.0440	0.978	0.986	0.992
0.0880	0.957	0.974	0.983
0.1320	0.938	0.962	0.975

Table 4.1 - Minimum glycol percentage for low water temperature

Evaporator Leaving Water Temperature (°C)	2	0	-2	-4	-6	-8
Ethylene glycol (%)	10	20	20	20	30	30
Propylene glycol (%)	10	20	20	30	30	30

Note: Minimum glycol percentage to be used with evaporator leaving water temperature below 4°C to prevent freezing of water circuit.

Table 4.2 - Minimum glycol percentage for low air temperature

Air Ambient Temperature (°C) (2)	-3	-8	-15	-23	-35
Ethylene glycol (%) (1)	10%	20%	30%	40%	50%
Air Ambient Temperature (°C) (2)	-3	-7	-12	-20	-32
Propylene glycol (%) (1)	10%	20%	30%	40%	50%

Note (1): Minimum glycol percentage to prevent freezing of water circuit at indicated air ambient temperature

Note (2): Air ambient temperature do exceed the operating limits of the unit, as protection of water circuit may be needed in winter season at non-working conditions

Table 5 - Correction factors for low evaporator leaving water temperature

Evaporator Leaving Water Temperature (°C)	2	0	-2	-4	-6	-8
Cooling Capacity	0.842	0.785	0.725	0.670	0.613	0.562
Compressor Power Input	0.950	0.940	0.920	0.890	0.870	0.840

Note: Correction factors have to be applied at working conditions: evaporator leaving water temperature 7°C

Table 6 - Correction factors for water and glycol mixture

	Ethylene Glycol (%)	10%	20%	30%	40%	50%
Ethylene Glycol	Cooling Capacity	0.991	0.982	0.972	0.961	0.946
	Compressor Power Input	0.996	0.992	0.986	0.976	0.966
	Flow Rate (Δt)	1.013	1.04	1.074	1.121	1.178
	Evaporator Pressure Drop	1.070	1.129	1.181	1.263	1.308
Propylene Glycol	Cooling Capacity	0.985	0.964	0.932	0.889	0.846
	Compressor Power Input	0.993	0.983	0.969	0.948	0.929
	Flow Rate (Δt)	1.017	1.032	1.056	1.092	1.139
	Evaporator Pressure Drop	1.120	1.272	1.496	1.792	2.128

How to use the Correction factors proposed in the previous tables

A) Mixture Water and Glycol --- Evaporator leaving water temperature > 4°C

- depending from the type and percentage (%) of glycol filled in the circuit (see table 4.2 and 6)
- multiply the Cooling Capacity, the Compressor Power Input by the Correction factor of Table 6
- starting from this new value of Cooling Capacity, calculate the Flow Rate (l/s) and the Evaporatore Pressure Drop (kPa)
- now multiply the new Flow Rate and the new Evaporator Pressure Drop by the Correction Factors of Table 6

Example

Unit Size: **EWWD120J-SS**

Mixture: Water

Working condition: ELWT 12/7°C – CLWT 30/35°C

- Cooling capacity: 121 kW

- Power input: 27.3 kW

- Flow rate (Δt 5°C): 5.78

- Evaporator pressure drop: 15kPa

Mixture: Water + Ethylene Glycol 30% (for a winter air temperature up to -15°C)

Working condition: ELWT 12/7°C – CLWT 30/35°C

- Cooling capacity: $121 \times 0.972 = 118$ kW

- Power input: $27.3 \times 0.986 = 26.9$ kW

- Flow rate (Δt 5°C): 5.64 (referred to 118 kW) $\times 1.074 = 6.06$ l/s

- Evaporator pressure drop: 16 (referred to 6.06 l/s) $\times 1.181 = 19$ kPa

B) Mixture Water and Glycol --- Evaporator leaving water temperature < 4°C

- depending from the type and percentage (%) of glycol filled in the circuit (see table 4.1 and 4.2 and table 6)
- depending from the evaporator leaving water temperature (see table 5)
- multiply the Cooling Capacity, the Compressor Power Input by the Correction factor of Table 5 and Table 6
- starting from this new value of Cooling Capacity, calculate the Flow Rate (l/s) and the Evaporator Pressure Drop (kPa)
- now multiply the new Flow Rate and the new Evaporator Pressure Drop by the Correction Factors of Table 6

Example

Unit Size: **EWWD120J-SS**

Mixture: Water

Working condition: ELWT 12/7°C – CLWT 30/35°C

- Cooling capacity: 121 kW

- Power input: 27.3 kW

- Flow rate (Δt 5°C): 5.78

- Evaporator pressure drop: 15kPa

Mixture: Water + Glycol 30% (for a low evaporator leaving temperature of 0/-5°C)

Working condition: ELWT 0/-5°C – CLWT 30/35°C

- Cooling capacity: $121 \times 0.641 \times 0.972 = 75.4$ kW

- Power input: $27.3 \times 0.880 \times 0.986 = 23.7$ kW

- Flow rate (Δt 5°C): $3.60 \text{ l/s} (\text{referred to } 75.4 \text{ kW}) \times 1.074 = 3.87 \text{ l/s}$

- Evaporator pressure drop: $7 \text{ kPa} (\text{referred to } 3.87 \text{ l/s}) \times 1.181 = 9 \text{ kPa}$

Water charge, flow and quality

Items (1) (6)	Cooling Water			Cooled Water			Heated water (a)			Tendency if out of criteria
	Circulating System		Once Flow	Circulating water [Below 20°C]	Supply water (4)	Circulating water [20°C ~ 80°C]	Supply water (4)	Circulating water [60°C ~ 80°C]	Supply water (4)	
	Circulating water	Supply water (4)	Flowing water	Circulating water [Below 20°C]	Supply water (4)	Circulating water [20°C ~ 80°C]	Supply water (4)	Circulating water [60°C ~ 80°C]	Supply water (4)	
pH	at 25°C	6.5 ~ 8.2	6.0 ~ 8.0	6.8 ~ 8.0	6.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	Corrosion + Scale
Electrical conductivity	[mS/m] at 25°C ($\mu\text{S/cm}$)	Below 80 (Below 300)	Below 30 (Below 400)	Below 80 (Below 800)	Below 80 (Below 800)	Below 30 (Below 300)	Below 30 (Below 300)	Below 30 (Below 300)	Below 30 (Below 300)	Corrosion + Scale
Chloride ion	[mgCl ²⁻ /l]	Below 50	Below 50	Below 200	Below 50	Below 50	Below 50	Below 50	Below 30	Corrosion + Scale
Sulfate ion	[mgSO ²⁻ /l]	Below 200	Below 50	Below 200	Below 50	Below 50	Below 50	Below 50	Below 30	Corrosion
M-alkalinity (pH4.8)	[mgCaCO ₃ /l]	Below 100	Below 50	Below 100	Below 50	Below 50	Below 50	Below 50	Below 30	Corrosion
Total hardness	[mgCaCO ₃ /l]	Below 200	Below 70	Below 200	Below 70	Below 70	Below 70	Below 70	Below 70	Scale
Calcium hardness	[mgCaCO ₃ /l]	Below 150	Below 50	Below 50	Below 50	Below 50	Below 50	Below 50	Below 50	Scale
Silica ion	[mgSiO ₂ /l]	Below 50	Below 30	Below 30	Below 30	Below 30	Below 30	Below 30	Below 30	Scale
Oxygen	(mg O ₂ / l)	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Corrosion
Particle size (mm)	Below 0.5	Below 0.5	Below 0.5	Below 0.5	Below 0.6	Below 0.6	Below 0.6	Below 0.6	Below 0.6	Erosion
Total dissolved solids (mg / l)	Below 1000	Below 1000	Below 1000	Below 1000	Below 1001	Below 1000	Below 1000	Below 1000	Below 1001	Erosion
Ethyleneglycol (weight conc.)	Below 60%	---	Below 60%	Below 60%	Below 60%	Below 60%	Below 60%	Below 60%	Below 60%	---
Nitrate ion	(mgNO ₃ - / l)	Below 100	Below 100	Below 100	Below 101	Below 100	Below 101	Below 100	Below 101	Corrosion
TOC Total organic carbon (mg / l)	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Scale
Iron	[mgFe/l]	Below 0.3	Below 1.0	Below 1.0	Below 0.3	Below 1.0	Below 0.3	Below 1.0	Below 0.3	Corrosion + Scale
Copper	[mgCu/l]	Below 0.3	Below 0.1	Below 1.0	Below 1.0	Below 1.0	Below 0.1	Below 1.0	Below 0.1	Corrosion
Sulfite ion	[mgS ²⁻ /l]	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Corrosion
Ammonium ion	[mgNH ⁺ /l]	Below 1.0	Below 0.1	Below 1.0	Below 0.1	Below 0.1	Below 0.3	Below 0.1	Below 0.1	Corrosion
Remaining chloride	[mgCl/l]	Below 0.3	Below 0.3	Below 0.3	Below 0.3	Below 0.3	Below 0.25	Below 0.3	Below 0.1	Corrosion
Free carbide	[mgCO ₂ /l]	Below 4.0	Below 4.0	Below 4.0	Below 4.0	Below 4.0	Below 0.4	Below 4.0	Below 0.4	Corrosion
Stability index	6.0 ~ 7.0	---	---	---	---	---	---	---	---	Corrosion + Scale

1 Names, definitions and units are according to JIS K 0101. Units and figures between brackets are old units published as reference only.

2 In case of using heated water (more than 40°C), corrosion is generally noticeable.

3 Especially when the iron materials is in direct contact with water without any protection shields, it is desirable to give the valid measure for corrosion. E.g. chemical measure

4 Supply water is considered drink water, industrial water and ground water except for genuine water, neutral water and soft water.

5 The above mentioned items are representable items in corrosion and scale cases.

6 The limits above have to be considered as a general prescription and can not totally assure the absence of corrosion and erosion.

Some particular combinations of elements or the presence of components not listed in the table of factors not considered may trigger corrosion phenomena.

Water content in cooling circuits

The cooled water distribution circuits should have minimum water content to avoid excessive compressors start and stop.

In fact, each time the compressor starts up, an excessive quantity of oil goes from the compressor sump and simultaneously there is a rise in the temperature of the compressor motor's stator due to the inrush current during the start-up.

To prevent damage to the compressors, it has been envisaged the application of a device to limit frequent stops and restarts.

During the span of one hour there will be no more than 6 starts of the compressor. The plant side should therefore ensure that the overall water content allows a more constant functioning of the unit and consequently greater environmental comfort.

The minimum water content per unit should be calculated using this simplified formula:

For 1 compressor unit

$$M \text{ (liters)} = (0.94 \times \Delta T(^{\circ}\text{C}) + 5.87) \times P(\text{kW})$$

For 2 compressors unit

$$M \text{ (liters)} = (0.1595 \times \Delta T(^{\circ}\text{C}) + 3.0825) \times P(\text{kW})$$

where:

M minimum water content per unit expressed in litres

P Cooling Capacity of the unit expressed in kW

ΔT evaporator entering / leaving water temperature difference expressed in $^{\circ}\text{C}$

This formula is valid for:

- standard microprocessor parameters

For more accurate determination of quantity of water, it is advisable to contact the designer of the plant.

Standard ratings

EWWD120~250J-SS

ELWT (°C)	Entering Condenser Water Temperature (°C)											
	15			20			25			30		
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)
120	4			118	21.7	139	113	23.9	137	108	26.4	135
	5			122	22.0	144	117	24.2	141	112	26.7	139
	6			126	22.3	148	121	24.5	145	116	27.0	143
	7			130	22.6	152	125	24.8	150	120	27.3	147
	8			134	22.9	157	129	25.1	154	124	27.6	152
	9			138	23.2	161	133	25.4	159	128	27.9	156
	10						137	25.8	163	132	28.2	160
	11						142	26.1	168	136	28.6	165
	12						146	26.4	172	140	28.9	169
	13						150	26.7	177	145	29.2	174
	14						155	27.1	182	149	29.6	179
	15						159	27.4	186	153	29.9	183
140	4			143	26.5	169	137	29.2	166	131	32.2	163
	5			148	26.8	174	142	29.6	172	136	32.6	168
	6			153	27.2	180	147	29.9	177	141	32.9	174
	7			158	27.5	185	152	30.3	182	146	33.3	179
	8			163	27.9	191	157	30.6	188	151	33.6	184
	9			168	28.2	197	162	31.0	193	156	34.0	190
	10						168	31.4	199	161	34.4	195
	11						173	31.8	205	166	34.8	201
	12						178	32.1	210	171	35.2	207
	13						184	32.5	216	177	35.6	212
	14						189	32.9	222	182	36.0	218
	15						195	33.3	228	188	36.4	224
150	4			153	30.8	183	147	34.1	181	141	37.5	179
	5			157	31.1	188	152	34.4	186	146	37.9	184
	6			162	31.4	193	156	34.7	191	151	38.2	189
	7			167	31.7	198	161	35.0	196	155	38.5	194
	8			171	32.1	203	166	35.4	201	160	38.9	199
	9			176	32.4	209	171	35.7	206	165	39.3	204
	10						176	36.1	212	169	39.6	209
	11						180	36.5	217	174	40.0	214
	12						186	36.8	222	179	40.4	220
	13						191	37.2	228	184	40.8	225
	14						196	37.6	233	189	41.1	230
	15						201	38.0	239	194	41.6	236
180	4			175	35.2	210	169	38.9	208	162	43.0	205
	5			181	35.6	216	174	39.4	214	167	43.4	211
	6			186	36.0	222	180	39.8	220	173	43.8	217
	7			192	36.4	228	185	40.2	225	178	44.2	222
	8			198	36.8	234	191	40.6	231	184	44.7	229
	9			203	37.3	241	197	41.0	238	190	45.1	235
	10						202	41.4	244	195	45.5	241
	11						208	41.9	250	201	46.0	247
	12						214	42.3	257	207	46.5	253
	13						221	42.8	263	213	46.9	260
	14						227	43.3	270	219	47.4	266
	15						233	43.7	277	225	47.9	273
210	4			205	39.2	244	197	43.5	240	189	47.9	237
	5			211	39.6	251	203	43.9	247	195	48.4	244
	6			217	40.0	257	209	44.4	254	202	48.9	250
	7			224	40.5	264	216	44.8	260	208	49.3	257
	8			230	40.9	271	222	45.3	267	214	49.8	264
	9			237	41.4	278	229	45.7	274	221	50.2	271
	10						235	46.2	281	227	50.7	278
	11						242	46.7	289	234	51.2	285
	12						249	47.2	296	240	51.7	292
	13						256	47.7	303	247	52.2	299
	14						263	48.2	311	254	52.7	307
	15						270	48.7	319	261	53.2	314
250	4			252	46.4	299	242	51.5	294	233	57.2	290
	5			261	46.9	308	250	52.0	302	239	57.6	297
	6			270	47.4	317	259	52.6	312	248	58.2	306
	7			279	47.8	327	268	53.1	321	256	58.7	315
	8			287	48.3	335	277	53.6	331	265	59.3	325
	9			294	48.7	343	285	54.1	339	274	59.9	334
	10						293	54.6	347	282	60.4	343
	11						300	55.0	355	290	60.9	351
	12						308	55.5	364	298	61.4	359
	13						317	56.0	373	306	62.0	368
	14						325	56.5	381	314	62.5	376
	15						333	57.0	390	322	63.0	385

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C

Data refers to 0,0176 m² °C/kW evaporator fouling factor

Data refers to 0,0440 m² °C/kW condenser fouling factor

ELWT (°C)	Entering Condenser Water Temperature (°C)												
	35			40			45			50			
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	
120	4	103	29.0	132	98.1	31.9	130	92.5	35.1	128	86.7	38.6	125
	5	107	29.3	136	102	32.3	134	95.9	35.4	131	90.0	38.9	129
	6	111	29.6	140	105	32.6	138	99.5	35.7	135	93.3	39.2	133
	7	115	30.0	145	109	32.9	142	103	36.1	139	96.7	39.5	136
	8	119	30.3	149	113	33.2	146	107	36.4	143	100	39.9	140
	9	123	30.6	153	117	33.6	150	111	36.8	147	104	40.2	144
	10	127	31.0	158	121	33.9	155	114	37.1	152	108	40.6	148
	11	131	31.3	162	125	34.2	159	118	37.5	156	112	40.9	152
	12	135	31.6	166	129	34.6	163	122	37.8	160	115	41.3	157
	13	139	32.0	171	133	35.0	168	126	38.2	165	119	41.7	161
	14	143	32.3	175	137	35.3	172	131	38.6	169	123	42.0	165
	15	147	32.7	180	141	35.7	177	135	38.9	173	127	42.4	170
140	4	125	35.5	161	118	39.0	157	111	42.9	154	104	47.1	151
	5	130	35.8	165	123	39.4	162	116	43.2	159	108	47.4	156
	6	134	36.2	170	127	39.7	167	120	43.6	164	112	47.8	160
	7	139	36.5	175	132	40.1	172	125	44.0	169	117	48.2	165
	8	144	36.9	181	137	40.5	177	129	44.3	173	121	48.6	170
	9	149	37.3	186	142	40.8	182	134	44.7	178	126	48.9	175
	10	154	37.7	192	146	41.2	188	139	45.1	184	130	49.3	180
	11	159	38.1	197	152	41.6	193	143	45.5	189	135	49.8	185
	12	164	38.5	203	157	42.1	199	148	45.9	194	140	50.2	190
	13	170	38.9	209	162	42.5	204	154	46.4	200	145	50.6	195
	14	175	39.3	214	167	42.9	210	159	46.8	206	150	51.0	201
	15	180	39.7	220	172	43.3	216	164	47.3	211	155	51.5	206
150	4	135	41.2	176	128	45.3	174	122	49.9	172	114	54.9	169
	5	140	41.6	181	133	45.7	178	126	50.3	176	118	55.3	174
	6	144	42.0	186	137	46.1	183	130	50.6	181	123	55.7	178
	7	149	42.3	191	142	46.4	188	135	51.0	186	127	56.1	183
	8	154	42.7	196	147	46.8	194	139	51.4	191	131	56.5	188
	9	158	43.1	201	151	47.2	199	144	51.8	196	136	56.9	193
	10	163	43.4	206	156	47.6	204	149	52.2	201	140	57.3	198
	11	168	43.8	211	161	48.0	209	153	52.6	206	145	57.8	203
	12	173	44.2	217	165	48.4	214	158	53.0	211	150	58.2	208
	13	177	44.6	222	170	48.8	219	163	53.4	216	155	58.6	213
	14	182	45.0	227	175	49.2	224	167	53.9	221	159	59.1	218
	15	187	45.4	233	180	49.6	230	172	54.3	227	164	59.5	223
180	4	155	47.4	202	147	52.2	199	140	57.5	197	131	63.1	194
	5	160	47.8	208	152	52.6	205	144	57.9	202	136	63.6	199
	6	165	48.2	214	157	53.0	210	149	58.3	207	141	64.1	205
	7	171	48.7	220	163	53.5	216	154	58.7	213	146	64.5	210
	8	176	49.1	225	168	54.0	222	159	59.2	219	150	64.9	215
	9	182	49.6	231	174	54.4	228	165	59.7	225	155	65.4	221
	10	187	50.0	237	179	54.9	234	170	60.2	231	161	65.9	227
	11	193	50.5	244	185	55.3	240	176	60.7	237	166	66.4	233
	12	199	50.9	250	191	55.8	246	182	61.1	243	172	66.9	239
	13	205	51.4	256	196	56.3	253	187	61.6	249	177	67.4	245
	14	211	51.9	263	202	56.8	259	193	62.1	255	183	67.9	251
	15	217	52.4	269	208	57.3	265	199	62.7	261	189	68.5	257
210	4	181	52.7	233	172	58.2	230	161	64.3	225	148	71.5	219
	5	187	53.2	240	178	58.6	236	167	64.8	232	153	72.0	225
	6	193	53.7	247	184	59.1	243	173	65.3	238	159	72.5	232
	7	200	54.2	254	190	59.6	249	178	65.8	244	165	73.0	238
	8	206	54.6	260	196	60.1	256	184	66.3	251	171	73.6	245
	9	212	55.1	267	202	60.6	263	191	66.8	257	177	74.1	251
	10	218	55.6	274	209	61.1	270	197	67.4	264	182	74.6	257
	11	225	56.1	281	215	61.6	277	203	67.9	271	188	75.2	264
	12	231	56.6	288	221	62.1	283	209	68.4	278	195	75.8	271
	13	238	57.1	295	228	62.6	290	216	69.0	285	201	76.4	278
	14	245	57.6	302	234	63.2	298	222	69.6	292	207	76.9	284
	15	252	58.2	310	241	63.7	305	228	70.1	299	213	77.5	291
250	4	223	63.4	286	211	70.2	282	200	77.7	277	187	86.1	273
	5	230	63.9	294	219	70.7	290	207	78.2	285	194	86.5	281
	6	237	64.3	301	226	71.2	298	214	78.7	293	201	87.0	288
	7	245	64.9	309	233	71.7	305	222	79.2	301	209	87.5	296
	8	253	65.5	318	240	72.2	313	229	79.7	309	216	88.0	304
	9	262	66.0	328	249	72.8	322	236	80.2	316	224	88.5	312
	10	270	66.7	337	257	73.4	331	243	80.8	324	231	89.0	320
	11	279	67.3	346	266	74.0	340	252	81.4	333	238	89.5	327
	12	287	67.8	355	275	74.7	350	260	82.1	343	246	90.1	336
	13	295	68.3	363	283	75.3	358	269	82.7	352	254	90.8	345
	14	303	68.9	371	291	75.8	366	278	83.4	361	263	91.5	354
	15	310	69.5	380	298	76.4	375	286	84.0	370	271	92.2	364

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C

Data refers to 0,0176 m² °C/kW evaporator fouling factor

Data refers to 0,0440 m² °C/kW condenser fouling factor

EWWD280~400J-SS

ELWT (°C)	Entering Condenser Water Temperature (°C)											
	15			20			25			30		
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)
280	4			281	56.0	337	271	60.5	331	259	65.7	324
	5			289	56.8	346	280	61.4	341	268	66.6	334
	6			297	57.6	355	287	62.2	350	277	67.5	345
	7			305	58.5	364	295	63.0	358	285	68.3	353
	8			314	59.3	373	304	63.9	367	293	69.1	362
	9			322	60.2	382	312	64.7	376	301	69.9	371
	10						320	65.6	386	309	70.8	380
	11						328	66.5	395	317	71.6	389
	12						337	67.4	404	326	72.5	398
	13						346	68.4	414	334	73.5	408
	14						354	69.3	424	343	74.4	417
	15						363	70.3	433	351	75.3	427
310	4			305	61.6	367	294	68.2	363	282	75.0	357
	5			314	62.2	377	304	68.8	372	292	75.8	368
	6			324	62.8	386	313	69.4	382	301	76.4	378
	7			333	63.4	397	322	70.0	392	310	77.0	387
	8			343	64.2	407	331	70.8	402	320	77.8	398
	9			352	64.8	417	341	71.4	413	329	78.6	408
	10						351	72.2	423	339	79.2	418
	11						361	73.0	434	349	80.0	429
	12						371	73.6	445	358	80.8	439
	13						381	74.4	456	368	81.6	450
	14						392	75.2	467	379	82.2	461
	15						402	76.0	478	389	83.2	472
330	4			328	66.0	394	316	73.0	389	303	80.5	384
	5			338	66.7	404	326	73.8	400	313	81.3	395
	6			348	67.4	415	336	74.5	411	324	82.0	406
	7			358	68.1	426	346	75.2	421	334	82.7	416
	8			369	68.9	438	357	76.0	433	344	83.6	427
	9			380	69.7	449	367	76.7	444	354	84.4	439
	10						378	77.5	456	365	85.1	450
	11						389	78.4	467	375	86.0	461
	12						400	79.1	479	386	86.9	473
	13						411	80.0	491	397	87.7	485
	14						423	80.9	504	408	88.5	497
	15						434	81.7	516	420	89.5	509
360	4			350	70.4	421	337	77.8	415	324	86.0	410
	5			361	71.2	432	349	78.8	427	335	86.8	421
	6			372	72.0	444	359	79.6	439	346	87.6	433
	7			384	72.8	456	371	80.4	451	357	88.4	445
	8			395	73.6	469	382	81.2	463	368	89.4	457
	9			407	74.6	481	393	82.0	475	379	90.2	469
	10						405	82.8	488	390	91.0	481
	11						417	83.8	501	402	92.0	494
	12						429	84.6	513	414	93.0	507
	13						441	85.6	527	426	93.8	520
	14						454	86.6	540	438	94.8	533
	15						466	87.4	554	451	95.8	546
380	4			380	74.4	454	366	82.4	448	351	90.9	442
	5			392	75.2	467	377	83.3	461	362	91.8	454
	6			403	76.0	479	389	84.2	473	375	92.7	467
	7			416	76.9	492	401	85.0	486	386	93.5	480
	8			428	77.7	505	413	85.9	499	398	94.5	492
	9			440	78.7	519	425	86.7	512	410	95.3	505
	10						438	87.6	525	422	96.2	518
	11						450	88.6	539	435	97.2	532
	12						463	89.5	553	447	98.2	545
	13						476	90.5	567	460	99.1	559
	14						490	91.5	581	473	100	573
	15						503	92.4	595	486	101	587
400	4			410	78.4	488	394	87.0	481	378	95.8	474
	5			422	79.2	501	406	87.8	494	390	96.8	487
	6			435	80.0	515	419	88.8	507	403	97.8	501
	7			447	81.0	528	431	89.6	521	416	98.6	514
	8			460	81.8	542	444	90.6	535	428	99.6	528
	9			474	82.8	557	457	91.4	549	441	100	541
	10						471	92.4	563	454	101	555
	11						484	93.4	577	467	102	570
	12						497	94.4	592	481	103	584
	13						511	95.4	607	494	104	599
	14						526	96.4	622	508	105	613
	15						540	97.4	637	522	106	628

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C
 Data refers to 0,0176 m² °C/kW evaporator fouling factor

Data refers to 0,0440 m² °C/kW condenser fouling factor

ELWT (°C)	Entering Condenser Water Temperature (°C)												
	35			40			45			50			
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	
280	4	246	71.6	318	235	78.4	313	223	86.1	309	209	94.5	304
	5	255	72.4	328	242	79.1	321	230	86.7	317	217	95.2	312
	6	264	73.3	337	251	79.9	331	237	87.4	325	225	95.9	321
	7	273	74.2	348	260	80.8	340	245	88.1	333	232	96.6	329
	8	282	75.1	357	269	81.6	350	254	89.0	343	239	97.2	336
	9	290	75.9	366	278	82.6	360	263	89.9	353	248	98.0	346
	10	298	76.7	374	286	83.4	369	272	90.8	363	256	98.9	355
	11	306	77.5	383	294	84.2	378	281	91.6	372	265	99.8	365
	12	314	78.4	392	302	85.0	387	289	92.5	381	274	101	375
	13	322	79.3	402	310	85.9	396	297	93.3	390	283	102	384
	14	331	80.2	411	318	86.7	405	305	94.1	399	290	102	393
	15	339	81.1	420	326	87.7	414	313	95.0	408	298	103	402
310	4	270	82.4	352	257	90.6	347	243	99.8	343	228	110	337
	5	279	83.2	362	266	91.4	357	252	101	352	236	111	347
	6	289	84.0	373	275	92.2	367	260	101	361	245	111	357
	7	298	84.6	383	284	92.8	377	269	102	371	254	112	366
	8	307	85.4	393	294	93.6	387	278	103	381	262	113	375
	9	316	86.2	403	303	94.4	397	288	104	391	271	114	385
	10	326	86.8	413	312	95.2	407	297	104	402	281	115	395
	11	335	87.6	423	321	96.0	417	307	105	412	290	116	406
	12	345	88.4	433	331	96.8	428	316	106	422	300	116	416
	13	355	89.2	444	341	97.6	438	325	107	432	309	117	426
	14	365	90.0	455	350	98.4	449	335	108	443	318	118	436
	15	375	90.8	466	360	99.2	459	345	109	453	328	119	447
330	4	289	88.6	378	276	97.5	373	261	107	369	245	118	363
	5	299	89.4	389	285	98.3	383	270	108	378	254	119	373
	6	310	90.2	400	295	99.1	394	279	109	388	263	120	383
	7	320	91.0	411	305	99.9	405	289	110	398	272	121	393
	8	330	91.8	422	315	101	416	298	111	409	281	121	403
	9	340	92.7	433	325	102	427	309	112	420	291	122	413
	10	350	93.4	444	335	103	438	319	112	432	301	123	424
	11	361	94.3	455	346	103	449	329	113	443	311	124	436
	12	372	95.1	467	356	104	460	339	114	454	322	125	447
	13	382	96.0	478	367	105	472	350	115	465	332	126	458
	14	393	96.9	490	377	106	483	360	116	476	342	127	469
	15	404	97.8	502	388	107	495	371	117	488	353	128	481
360	4	309	94.8	404	295	104	399	279	115	394	261	126	388
	5	320	95.6	415	304	105	409	289	116	405	271	127	399
	6	331	96.4	427	315	106	421	298	117	415	281	128	410
	7	342	97.4	439	325	107	432	308	117	425	291	129	420
	8	353	98.2	451	337	108	445	319	118	437	301	130	430
	9	364	99.2	463	348	109	457	330	119	449	311	131	441
	10	375	100	475	359	110	468	341	120	461	322	132	453
	11	386	101	487	370	111	480	352	121	473	333	133	465
	12	398	102	500	381	112	493	363	122	485	344	134	478
	13	410	103	513	393	113	505	374	123	498	355	135	490
	14	422	104	525	404	114	518	386	124	510	366	136	502
	15	434	105	539	416	115	531	397	125	523	377	137	514
380	4	335	100	435	319	110	430	301	122	423	278	135	413
	5	347	101	448	330	111	441	312	123	434	289	136	425
	6	358	102	460	341	112	453	322	124	446	300	137	437
	7	370	103	473	353	113	466	332	125	457	311	138	448
	8	382	104	486	364	114	479	344	126	469	321	139	460
	9	394	105	499	376	115	491	356	127	482	332	140	471
	10	406	106	511	388	116	504	367	128	495	343	141	484
	11	418	107	525	400	117	517	379	129	508	355	142	496
	12	430	108	538	412	118	530	391	130	520	367	143	509
	13	443	109	551	424	119	543	403	131	533	379	144	522
	14	456	110	565	436	120	556	415	132	547	390	145	535
	15	469	111	579	449	121	570	427	133	560	402	146	548
400	4	362	105	467	344	116	460	322	129	451	295	143	438
	5	374	106	480	355	117	473	334	130	464	307	144	451
	6	386	107	494	367	118	485	346	131	476	318	145	463
	7	399	108	507	380	119	499	357	132	489	330	146	476
	8	412	109	521	392	120	512	369	133	502	342	147	489
	9	424	110	534	405	121	526	381	134	515	353	148	501
	10	437	111	548	417	122	540	394	135	529	365	149	514
	11	450	112	562	430	123	553	406	136	542	377	150	527
	12	463	113	576	443	124	567	419	137	556	390	152	541
	13	476	114	590	455	125	581	431	138	569	402	153	555
	14	490	115	605	469	126	595	444	139	583	414	154	568
	15	503	116	620	482	127	609	457	140	597	427	155	582

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C
Data refers to 0,0176 m² °C/kW evaporator fouling factor
Data refers to 0,0440 m² °C/kW condenser fouling factor

EWWD450~560J-SS

ELWT (°C)	Entering Condenser Water Temperature (°C)											
	15			20			25			30		
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)
450	4			457	85.6	543	439	95.0	534	421	105	527
	5			472	86.5	559	454	95.9	550	435	106	541
	6			487	87.4	575	468	97.0	565	449	107	557
	7			503	88.3	591	484	97.9	581	464	108	572
	8			517	89.2	606	499	98.9	598	479	109	588
	9			531	90.1	621	513	100	613	495	110	605
	10						528	101	629	509	111	620
	11						542	102	644	524	112	636
	12						557	103	660	538	113	651
	13						572	104	676	553	114	667
	14						587	105	692	568	115	683
	15						603	106	709	583	116	699
500	4			505	92.8	598	484	103	587	465	114	580
	5			522	93.8	616	501	104	605	479	115	594
	6			540	94.8	635	518	105	623	496	116	612
	7			558	95.6	653	536	106	642	513	117	630
	8			573	96.6	670	554	107	661	530	119	649
	9			589	97.4	686	570	108	678	548	120	668
	10						585	109	694	565	121	685
	11						601	110	711	580	122	702
	12						617	111	728	596	123	719
	13						633	112	745	612	124	736
	14						649	113	762	628	125	753
	15						666	114	780	644	126	770
530	4			534	102	636	513	112	625	491	123	614
	5			550	104	654	530	113	643	507	124	631
	6			567	105	672	547	115	661	525	126	651
	7			584	106	690	563	116	679	541	127	668
	8			600	108	708	581	118	698	558	128	687
	9			616	109	725	596	119	715	575	130	705
	10						613	120	733	591	131	723
	11						629	122	750	607	133	740
	12						645	123	768	624	134	757
	13						662	124	786	640	136	776
	14						679	126	805	657	137	794
	15						696	127	823	673	138	812
560	4			563	112	675	541	121	662	517	131	649
	5			578	114	692	559	123	682	536	133	669
	6			594	115	710	575	124	699	554	135	689
	7			611	117	728	591	126	717	570	137	707
	8			627	119	746	607	128	735	586	138	724
	9			644	120	764	623	129	753	602	140	742
	10						640	131	771	618	142	760
	11						657	133	790	635	143	778
	12						674	135	809	651	145	796
	13						691	137	828	668	147	815
	14						709	139	847	686	149	834
	15						726	141	867	703	151	853

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C
 Data refers to 0,0176 m² °C/kW evaporator fouling factor
 Data refers to 0,0440 m² °C/kW condenser fouling factor

ELWT (°C)	Entering Condenser Water Temperature (°C)												
	35			40			45			50			
	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	Cc (kW)	Pi (kW)	Hc (kW)	
450	4	404	116	520	383	128	512	361	142	503	335	158	492
	5	417	117	534	397	129	526	374	143	517	348	159	506
	6	430	118	548	410	130	540	387	144	531	361	160	520
	7	444	119	563	423	131	554	400	145	545	374	161	534
	8	459	120	579	437	132	569	414	146	560	387	162	549
	9	474	121	595	451	133	585	427	147	574	400	163	563
	10	489	122	611	466	135	600	440	148	589	413	164	577
	11	504	123	627	481	136	617	455	149	604	426	165	591
	12	518	124	643	496	137	633	470	151	620	440	166	606
	13	533	125	658	511	138	649	485	152	637	455	167	622
	14	547	127	674	525	139	664	500	153	653	470	168	638
	15	562	128	690	539	140	679	514	154	668	485	170	654
500	4	446	127	572	423	140	563	399	155	554	374	172	546
	5	460	128	587	438	141	579	413	156	570	388	173	561
	6	473	129	602	453	142	595	428	157	586	403	174	577
	7	489	130	619	467	143	610	444	158	602	417	175	592
	8	506	131	637	481	144	625	458	159	618	432	176	608
	9	523	132	655	497	146	643	472	160	632	448	177	625
	10	541	133	674	514	147	661	487	162	649	461	178	639
	11	558	135	693	532	148	680	504	163	667	475	179	654
	12	574	136	709	550	149	699	521	164	685	491	180	671
	13	589	137	726	566	151	716	538	165	704	508	182	690
	14	605	138	743	581	152	733	556	167	723	525	183	708
	15	621	139	760	597	153	750	571	168	739	543	184	727
530	4	469	135	604	446	149	594	423	164	586	396	181	577
	5	485	136	621	461	150	611	437	165	602	411	182	593
	6	501	138	638	477	151	628	452	166	618	426	183	609
	7	518	139	657	493	153	645	467	167	635	441	184	625
	8	535	141	675	509	154	663	483	169	652	455	185	640
	9	551	142	693	527	155	682	499	170	669	471	187	658
	10	568	143	712	543	157	700	516	172	687	487	188	675
	11	585	145	730	559	158	718	533	173	706	503	189	692
	12	601	146	747	576	160	736	549	175	724	520	191	711
	13	617	148	764	593	161	754	566	176	742	537	192	729
	14	633	149	782	609	163	771	583	178	760	553	194	747
	15	650	151	800	625	164	789	598	179	777	570	196	765
560	4	493	143	636	469	157	626	446	172	618	418	189	607
	5	510	145	655	484	158	643	460	173	634	434	190	624
	6	528	147	675	502	160	661	475	175	649	450	192	642
	7	547	148	695	519	162	681	491	176	667	464	193	657
	8	564	150	714	537	163	700	508	178	686	478	194	673
	9	579	152	731	556	165	721	526	180	706	495	196	691
	10	595	153	749	571	167	738	544	182	726	513	198	710
	11	612	155	767	587	168	756	562	183	745	530	200	730
	12	628	157	785	603	170	773	577	185	762	549	201	750
	13	645	159	803	619	172	791	593	187	780	565	203	768
	14	661	160	822	636	173	809	609	188	797	581	205	786
	15	678	162	841	653	175	828	625	190	815	597	207	803

Notes:

Cc (cooling capacity) - Pi (unit power input) - ELWT (Evaporator leaving water temperature - Δt 5°C) - Condenser Water temperature Δt 5°C

Data refers to 0,0176 m² °C/kW evaporator fouling factor

Data refers to 0,0440 m² °C/kW condenser fouling factor

Evaporator and condenser pressure drops

EWWD~J-SS

	120	140	150	180	210	250	280	310	330	360
Cooling Capacity (kW)	120	146	155	178	208	256	285	310	334	357
Water Flow (l/s) - Evaporator	5.73	6.98	7.41	8.50	9.94	12.25	13.63	14.81	15.96	17.06
Evaporator Pressure Drops (kPa)	15	13	40	38	36	28	33	40	40	38
Water Flow (l/s) - Condenser	7.04	8.57	9.25	10.62	12.30	15.06	16.89	18.49	19.91	21.28
Condenser Pressure Drops (kPa)	20	12	11	11	11	16	26	11	11	11

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser water in/out: 30/35°C

	380	400	450	500	530	560
Cooling Capacity (kW)	386	416	464	513	541	570
Water Flow (l/s) - Evaporator	18.44	19.88	22.17	24.51	25.85	27.23
Evaporator Pressure Drops (kPa)	38	36	36	28	28	33
Water Flow (l/s) - Condenser	23.15	24.59	27.33	30.10	31.92	33.78
Condenser Pressure Drops (kPa)	11	11	11	16	16	26

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser water in/out: 30/35°C

Evaporator and condenser pressure drops

To determinate the evaporator or condenser pressure drop for different versions or at different working condition, please refer to the following formula:

$$PD_2 \text{ (kPa)} = PD_1 \text{ (kPa)} \times \left(\frac{Q_2 \text{ (l/s)}}{Q_1 \text{ (l/s)}} \right)^{1.8}$$

where:

PD₂	Pressure drop to be determinated (kPa)
PD₁	Pressure drop at nominal condition (kPa)
Q₂	water flow at new working condition (l/s)
Q₁	water flow at nominal condition (l/s)

How to use the formula: Example (evaporator)

The unit EWWD280J-SS has been selected for working at the following conditions:

- evaporator water in/out: 11/6°C
- condenser water in/out: 30/35°C

The cooling capacity at these working conditions is: 277 kW

The evaporator water flow at these working conditions is: 13.23 l/s

The unit EWWD280J-SS at nominal working conditions has the following data:

- evaporator water in/out: 12/7°C
- condenser water in/out: 30/35°C

The cooling capacity at these working conditions is: 285 kW

The evaporator water flow at these working conditions is: 13.62 l/s

The evaporator pressure drop at these working conditions is: 33 kPa

The evaporator pressure drop at the selected working condition will be:

$$PD_2 \text{ (kPa)} = 33 \text{ (kPa)} \times \left(\frac{13.23 \text{ (l/s)}}{13.62 \text{ (l/s)}} \right)^{1.8}$$


$$PD_2 \text{ (kPa)} = 31 \text{ (kPa)}$$

NOTE

If the calculated evaporator water pressure drop is below 10 kPa or above 100 kPa please contact the factory for dedicated evaporator.

Dimensions

EWWD~J-SS / 1 circuit

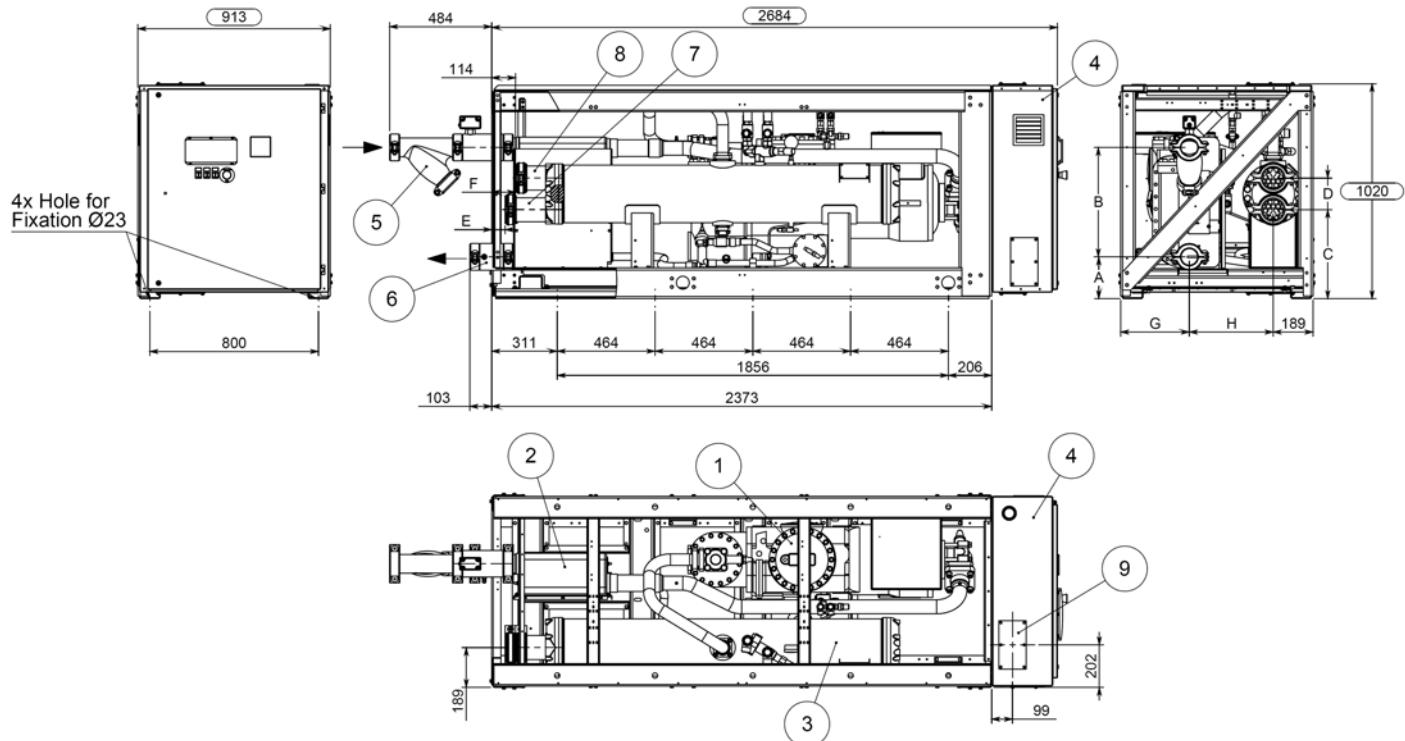


Models	Dimensions (mm)							
	A	B	C	D	E	F	G	H
EWWD~J -SS								
120	198	519	445	115	54	104	326	398
140	198	519	422	150	64	114	326	398
150	198	568	422	150	64	114	311	413
180	198	568	422	150	64	114	311	413
210	198	568	422	150	64	114	311	413
250	198	568	422	150	64	114	311	413
280	198	568	422	150	64	114	311	413

LEGEND

1. Compressor
2. Evaporator
3. Condenser
4. Electrical panel
5. Evaporator water inlet
6. Evaporator water outlet
7. Condenser water inlet connection
8. Condenser water outlet connection
9. Power connections slot

EWWD~J-SS / 2 circuits

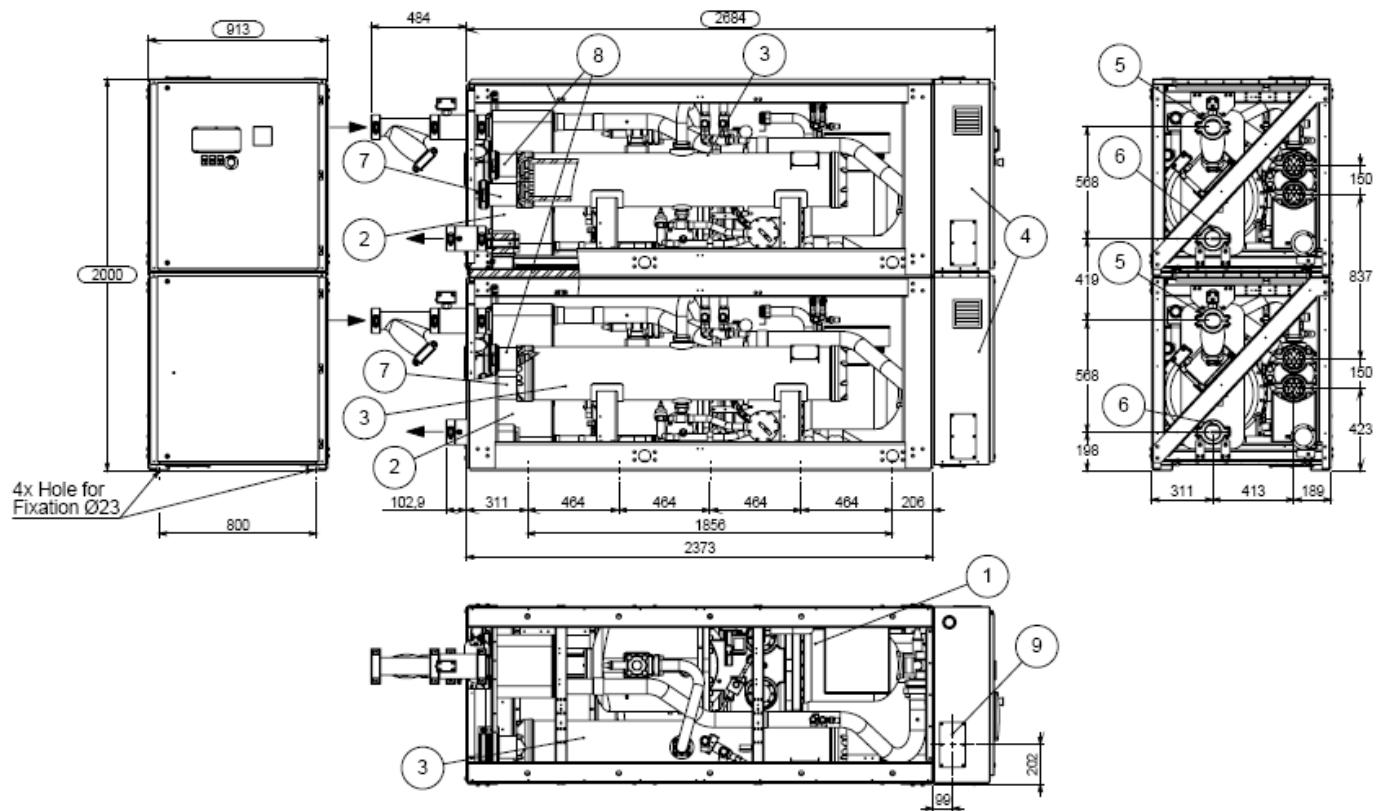

Note. Dimension refers to 2 circuit units (size from 310-560).

LEGEND

1. Compressor
2. Evaporator
3. Condenser
4. Electrical panel
5. Evaporator water inlet
6. Evaporator water outlet
7. Condenser water inlet connection
8. Condenser water outlet connection
9. Power connections slot

Installation notes

Warning

Installation and maintenance are to be performed only by qualified personnel who are familiar with local codes and regulations, and who are experienced with this type of equipment. Must be avoided the unit installation in places that could be considered dangerous for all the maintenance operations.

Warning

Installation and maintenance are to be performed only by qualified personnel who are familiar with local codes and regulations, and who are experienced with this type of equipment. Must be avoided the unit installation in places that could be considered dangerous for all the maintenance operations.

Handling

The chiller is mounted on heavy wooden skids to protect the unit from accidental damage and to permit easy handling and moving. It is recommended that all moving and handling be performed with the skids under the unit when possible and that the skids not be removed until the unit is in the final location.

If the unit must be hoisted, it is necessary to lift the unit by attaching cables or chains at the lifting holes in the evaporator tube sheets. Spreader bars must be used to protect the control cabinet and the other areas of the chiller.


Location

A leveled and sufficiently strong floor is required. If necessary, additional structural members should be provided to transfer the weight of the unit to the nearest beams.

Rubber-in-shear isolators can be furnished and field placed under each corner of the package. A rubber anti-skid pad should be used under isolators if hold-down bolts are not used. Vibration isolator in all water piping connected to the chiller is recommended to avoid straining the piping and transmitting vibration and noise.

Minimum space requirements

Every side of the machine must be accessible for all post-installation maintenance activities. The minimum space required is shown on the following drawing:

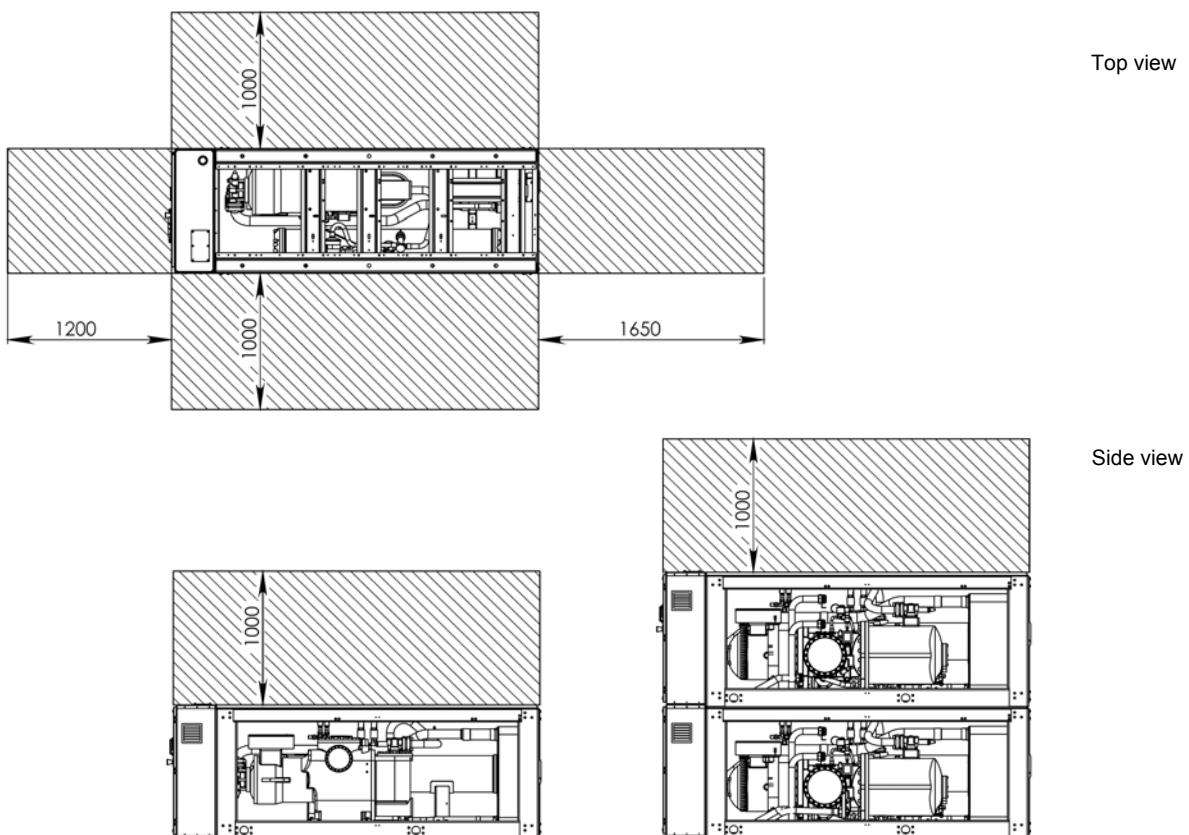

Minimum clearance requirements for machine maintenance

Technical specification for water cooled screw chillers

General

The water cooled screw chiller will be designed and manufactured in accordance with following European directives:

Construction of pressure vessel	97/23/EC (PED)
Machinery Directive	2006/42/EC
Low Voltage	2006/95/EC
Electromagnetic Compatibility	2004/108/EC
Electrical & Safety codes	EN 60204-1 / EN 60335-2-40
Manufacturing Quality Stds	UNI – EN ISO 9001:2004

The unit will be tested at full load in the factory at the nominal working conditions and water temperatures. Before shipment a full test will be held to avoid any losses.

Chiller will be delivered to the job site completely assembled and charged with right refrigerant and oil quantity.

Comply with the manufacturer instructions for rigging and handling equipment.

The unit will be able to start up and operate as standard at full load and condenser entering fluid temperature from °C to °C with an evaporator leaving fluid temperature between °C and °C

All units published performances have to be certified by **Eurovent**.

Refrigerant

Only HFC 134a will be accepted.

Performance

- ✓ Number of water cooled screw chiller:
- ✓ Cooling capacity for single water cooled screw chiller: kW
- ✓ Power input for single water cooled screw chiller in cooling mode: kW
- ✓ Plate to plate evaporator entering water temperature in cooling mode: °C
- ✓ Plate to plate evaporator leaving water temperature in cooling mode: °C
- ✓ Plate to plate evaporator water flow: l/s
- ✓ Shell & tube condenser entering water temperature in cooling mode: °C
- ✓ Shell & tube condenser leaving water temperature in cooling mode: °C
- ✓ Shell & tube condenser water flow: l/s
- ✓ The unit should work with electricity in range 400V ±10%, 3ph, 50Hz without neutral and shall only have one power connection point.

Unit description

Chiller shall include as standard: 1 or 2 independent refrigerant circuits, semi-hermetic rotary single screw compressors, electronic expansion device (EEXV), direct expansion plate to plate evaporator and shell & tube condenser, R134a refrigerant, lubrication system, motor starting components, control system and all components necessary for safe and stable unit operation.

Chiller will be factory assembled on a robust base-frame made of zinc coated steel, protected by an epoxy paint.

Noise level and vibration

Sound pressure level at 1 meter distance in free field, semispheric conditions, shall not exceeddB(A). The sound pressure levels must be rated in accordance to ISO 3744.

Other types of rating unacceptable. Vibration level should not exceed 2 mm/s.

Dimension

Unit dimensions shall not exceed following indications:

- ✓ unit length mm,
- ✓ unit width mm,
- ✓ unit height mm.

Chiller components

Compressors

- ✓ Semi-hermetic, single-screw type with one main helical rotor meshing with gaterotor. The gaterotor will be constructed of a carbon impregnated engineered composite material. The gaterotor supports will be constructed of cast iron.
- ✓ The oil injection shall be used in order to get high EER (Energy Efficiency Ratio) also at high condensing pressure and low sound pressure levels in each load condition.
- ✓ Refrigerant system differential pressure shall provide oil flow through service replaceable, 0.5 micron, full flow, cartridge type oil filter internal to compressor.
- ✓ Refrigerant system differential pressure shall provide oil injection on all moving compressor parts to correctly lubricate them. Electrical oil pump lubricating system is not acceptable.
- ✓ The compressor's oil cooling must be realized, when necessary, by refrigerant liquid injection. External dedicated heat exchanger and additional piping to carry the oil from the compressor to heat exchanger and viceversa will be not accepted.
- ✓ The compressor shall be provided with an external, high efficiency, cyclonic type oil separator and with built-in oil filter, cartridge type.
- ✓ The compressor shall be direct electrical driven, without gear transmission between the screw and the electrical motor.
- ✓ Shall be present two thermal protection realized by a thermistor for high temperature protection: one temperature sensor to protect electrical motor and another sensor to protect unit and lubricating oil from high discharge gas temperature.
- ✓ The compressor shall be equipped with an electric oil-crankcase heater.
- ✓ Compressor shall be fully field serviceable. Compressor that must be removed and returned to the factory for service shall be unacceptable.

Cooling capacity control system

- ✓ Each unit will have a microprocessor for the control of compressor slide valve's position and the instantaneous RPM value of the motor.
- ✓ The unit capacity control shall be infinitely modulating, from 100% down to 25% for each circuit (from 100% down to 12,5% of full load for unit with 2 compressors). The chiller shall be capable of stable operation to a minimum of 12,5% of full load without hot gas bypass.
- ✓ Step unloading unacceptable because of evaporator leaving water temperature fluctuation and low unit efficiency at partial load.
- ✓ The system shall stage the unit based on the leaving evaporator water temperature that shall be controlled by a PID (Proportional Integral Derivative) loop.
- ✓ Unit control logic shall manage frequency level of the compressor electric motor to exactly match plant load request in order to keep constant the set point for delivered chilled water temperature. In this operating condition unit control logic shall modulate electrical frequency level in a range lower and upper the nominal electrical network value fixed at 50 Hz.
- ✓ The microprocessor unit control shall detect conditions that approach protective limits and take self-corrective action prior to an alarm occurring. The system shall automatically reduce chiller capacity when any of the following parameters are outside their normal operating range:
 - High condenser pressure
 - Low evaporation refrigerant temperature
 - High compressor motor amps

Evaporator

- ✓ The units shall be equipped with a Direct Expansion plate to plate evaporator with copper tubes rolled into steel tubesheets.
- ✓ The external shell shall be linked with an electrical heater to prevent freezing down to -28°C ambient temperature, controlled by a thermostat and shall be insulated with flexible, closed cell polyurethane insulation material (10 mm thick).
- ✓ The evaporator will have 1 circuit.
- ✓ The water connections shall be threaded type connections as standard to ensure quick mechanical disconnection between the unit and the hydronic network.
- ✓ Evaporator is manufactured in accordance to PED approval.

Condensers

- ✓ Condensers will be shell and cleanable, through-tube type.
- ✓ The unit will have one condenser per circuit.
- ✓ Each condenser shall have a carbon steel and seamless, integrally finned high efficiency copper tubes, roll expanded into heavy carbon steel tube sheets.
- ✓ Water heads shall be removable and include vent and drain plugs.
- ✓ Condensers will come complete with liquid shut-off valve, spring loaded relief valve.

Refrigerant circuit

Each circuit shall include as standard: electronic expansion device piloted by unit's microprocessor control, compressor discharge shut-off valve, suction line shut-off valve, replaceable core filter-drier, sight glass with moisture indicator and insulated suction line.

Control panel

- ✓ Field power connection, control interlock terminals, and unit control system should be centrally located in an electric panel (IP 54). Power and starting controls should be separate from safety and operating controls in different compartments of the same panel.
- ✓ Starting shall be Wye-Delta type as standard.
- ✓ Operating and safety controls should include energy saving control; emergency stop switch; overload protection for compressor motor; high and low pressure cut-out switch (for each refrigerant circuit); anti-freeze thermostat; cut-out switch for each compressor.
- ✓ All of the information regarding the unit will be reported on a display and with the internal built-in calendar and clock that will switch the unit ON/OFF during day time all year long.
- ✓ The following features and functions shall be included:
 - resetting chilled water temperature by controlling the return water temperature or by a remote 4-20 mA DC signal or by controlling the external ambient temperature;
 - soft load function to prevent the system from operating at full load during the chilled fluid pulldown period;
 - password protection of critical parameters of control;
 - start-to-start and stop-to-star timers to provide minimum compressor off-time with maximum motor protection;
 - communication capability with a PC or remote monitoring;
 - discharge pressure control through intelligent cycling of condenser fans;
 - lead-lag selection by manual or automatically by circuit run hours;
 - double set point for brine unit version;
 - scheduling via internal time clock to allow programming of a yearly start-stop schedule accommodating weekends and holidays.

Optional High Level Communications Interface

The controller as a minimum shall be capable of providing the data shown in the above list, using the following options:

- RS485 Serial card
- RS232 Serial card
- LonWorks interface to FTT10A Transceiver.
- Bacnet Compatible
- Use of Compass Points (manufactured by North Communications) to allow communications with such as Honeywell, Satchwell, Johnson Controls, Trend etc.

PRINTED ON RECYCLED PAPER AND MADE BY A MEMBER OF DAIKIN



In all of us,
a green heart

Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco-design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



The present leaflet is drawn up by way of information only and does not constitute an offer/binding upon Daikin Europe N.V. DaikinEurope N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by DaikinEurope N.V.

Daikin products are distributed by

FSC

ECDEN10-XXX



Daikin Europe N.V. participates in the European Certification Programme for Air Conditioners (AC), Liquid Chilling Packages (LCP) and Fan Coil Units (FC). The certified data of certified models are listed in the European Directory. Multi units are European certified for combinations up to 2 indoor units.