


FDXS50F

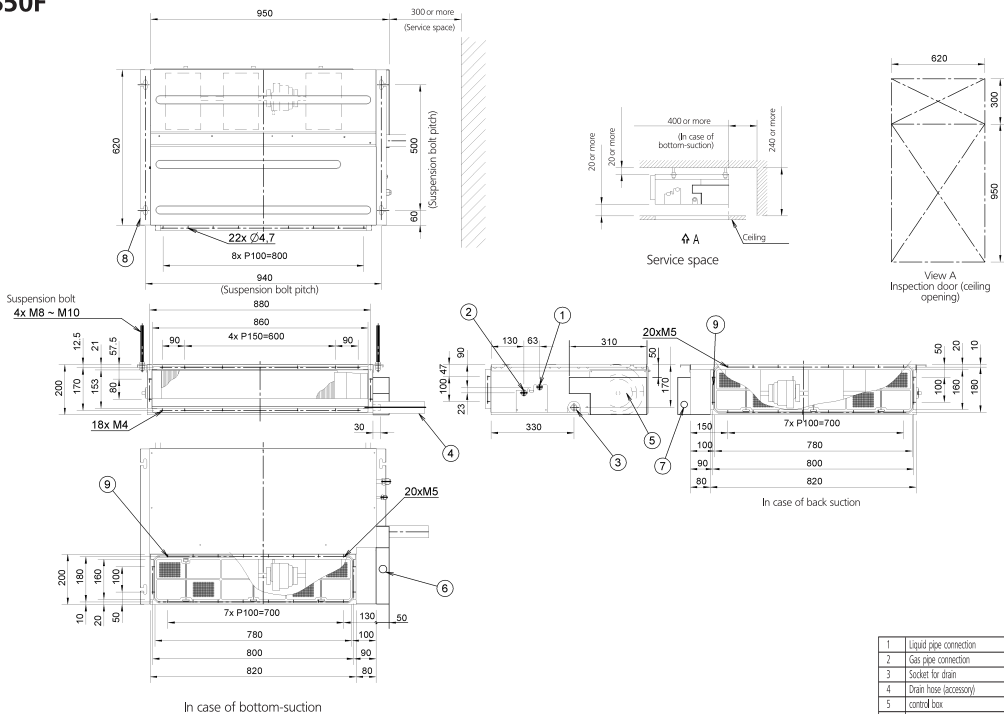

Note:

1. In case of back-suction, mount chamber cover to bottom side of the unit.
2. In case of bottom-suction, mount chamber cover to back side of the unit.
3. Location of unit's name plate: control box cover.
4. Mount the air filter at the suction side. (Use an air filter whose dust collecting efficiency is at least 50% in a gravimetric technique.) It can not be equipped with air filter (accessory) when connecting duct to suction side.

1	Liquid pipe connection	ϕ 6A fibre connection
2	Gas pipe connection	ϕ 12.7 fibre connection
3	Socket for drain	VP 20 (CO ϕ 26, ID ϕ 20)
4	Drain hose (accessory)	ID ϕ 25 (Duct)
5	control box	
6	Transmission wiring	
7	Power supply connection	
8	Suspension bracket	
9	Air filter (accessory)	